



1 SOUTHWEST CORNER VIEW OF THE BELNORD



2 SOUTHEAST CORNER VIEW OF THE BELNORD

LIST OF DRAWINGS


- 01 SITE PLAN AND VIEWS
- 02 EXISTING ROOF PLAN
- 03 PROPOSED ROOF PLAN
- 04 EXISTING CONDITIONS AT ROOF
- 05 EXISTING SOUTH ELEVATION
- 06 PROPOSED SOUTH ELEVATION
- 07 EXISTING AND PROPOSED EAST ELEVATION
- 08 PROPOSED SECTIONS
- 09 PROPOSED ELEVATION (EQUIPMENT)
- 10 BOILER EQUIPMENT DETAILS / PLAN
- 11 BOILER EQUIPMENT DETAILS / SECTION
- 12 VISIBILITY DIAGRAM
- 13 EAST FACADE PHOTOGRAPHS
- 14 EAST FACADE PHOTOGRAPHS
- 15 SOUTH FACADE PHOTOGRAPHS
- 16 2004/ 2016 MEP EQUIPMENT VISIBILITY COMPARISON
- 17 2004/ 2016 MEP EQUIPMENT VISIBILITY COMPARISON
- 18 2004/ 2016 MEP EQUIPMENT VISIBILITY COMPARISON
- 19 2004/ 2006 MEP EQUIPMENT COMPARISON
- 20 EXISTING BOILER INFRASTRUCTURE

SUPPORTING DOCUMENTATION – MEP EQUIPMENT ROOF STUDY

- RS1 SITE PLAN AND VIEWS
- RS2 ROOF PLAN
- RS3 SUMMARY OF OPTIONS AND SITE MAP

SUPPORTING DOCUMENTATION – DEPARTMENT OF BUILDINGS FILING SET

- BL-001 BOILER SYMBOLS, ABBREVIATIONS, SCHEDULES, AND DETAILS
- BL-101 BOILER ROOM PLAN, ELEVATION, & HEATING SYSTEM PIPING DIAGRAM
- BL-102 ROOF MECHANICAL PLAN
- BL-201 HEATING SYSTEM PIPING DIAGRAM
- BL-202 HEATING SYSTEM CONTROL DIAGRAM
- BL-203 HEATING SYSTEM CONTROL DIAGRAM

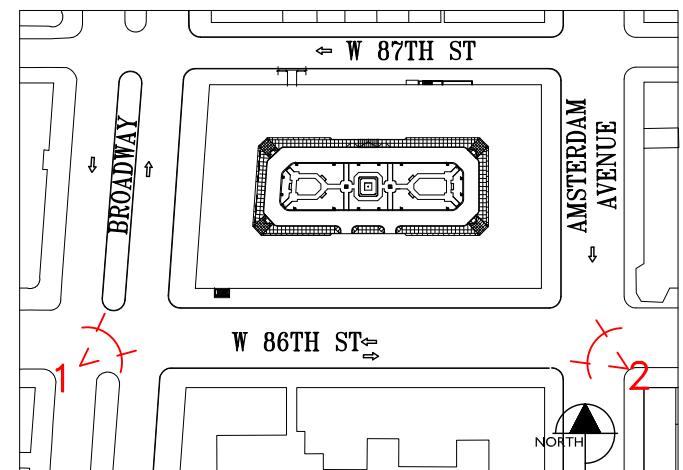

3 SITE PLAN

THE BELNORD
225 WEST 86TH STREET
NEW YORK, NEW YORK

NEW YORK CITY
LANDMARKS PRESERVATION
COMMISSION SUBMISSION

**UPPER ROOF
MECHANICAL**

MEPF Engineer
Plus Group Consulting Engineers
231 WEST 29th STREET
#706
New York, NY 10001
(212) 233-2700

SITE PLAN AND VIEWS

DRAWING TITLE

DRAWN BY: NA
CHECKED BY: IM
SCALE: AS NOTED
PROJ. NO. NA
DATE 10 MARCH 2016

01
DRAWING NO.

LEGEND

 EXISTING MECHANICAL EQUIPMENT

 PENTHOUSE ROOF


 EXISTING ELEVATOR BULKHEAD

 EXISTING SKYLIGHT

 EXISTING PIPING

 1 PHOTOGRAPH KEY FOR SHEET 04

BROADWAY

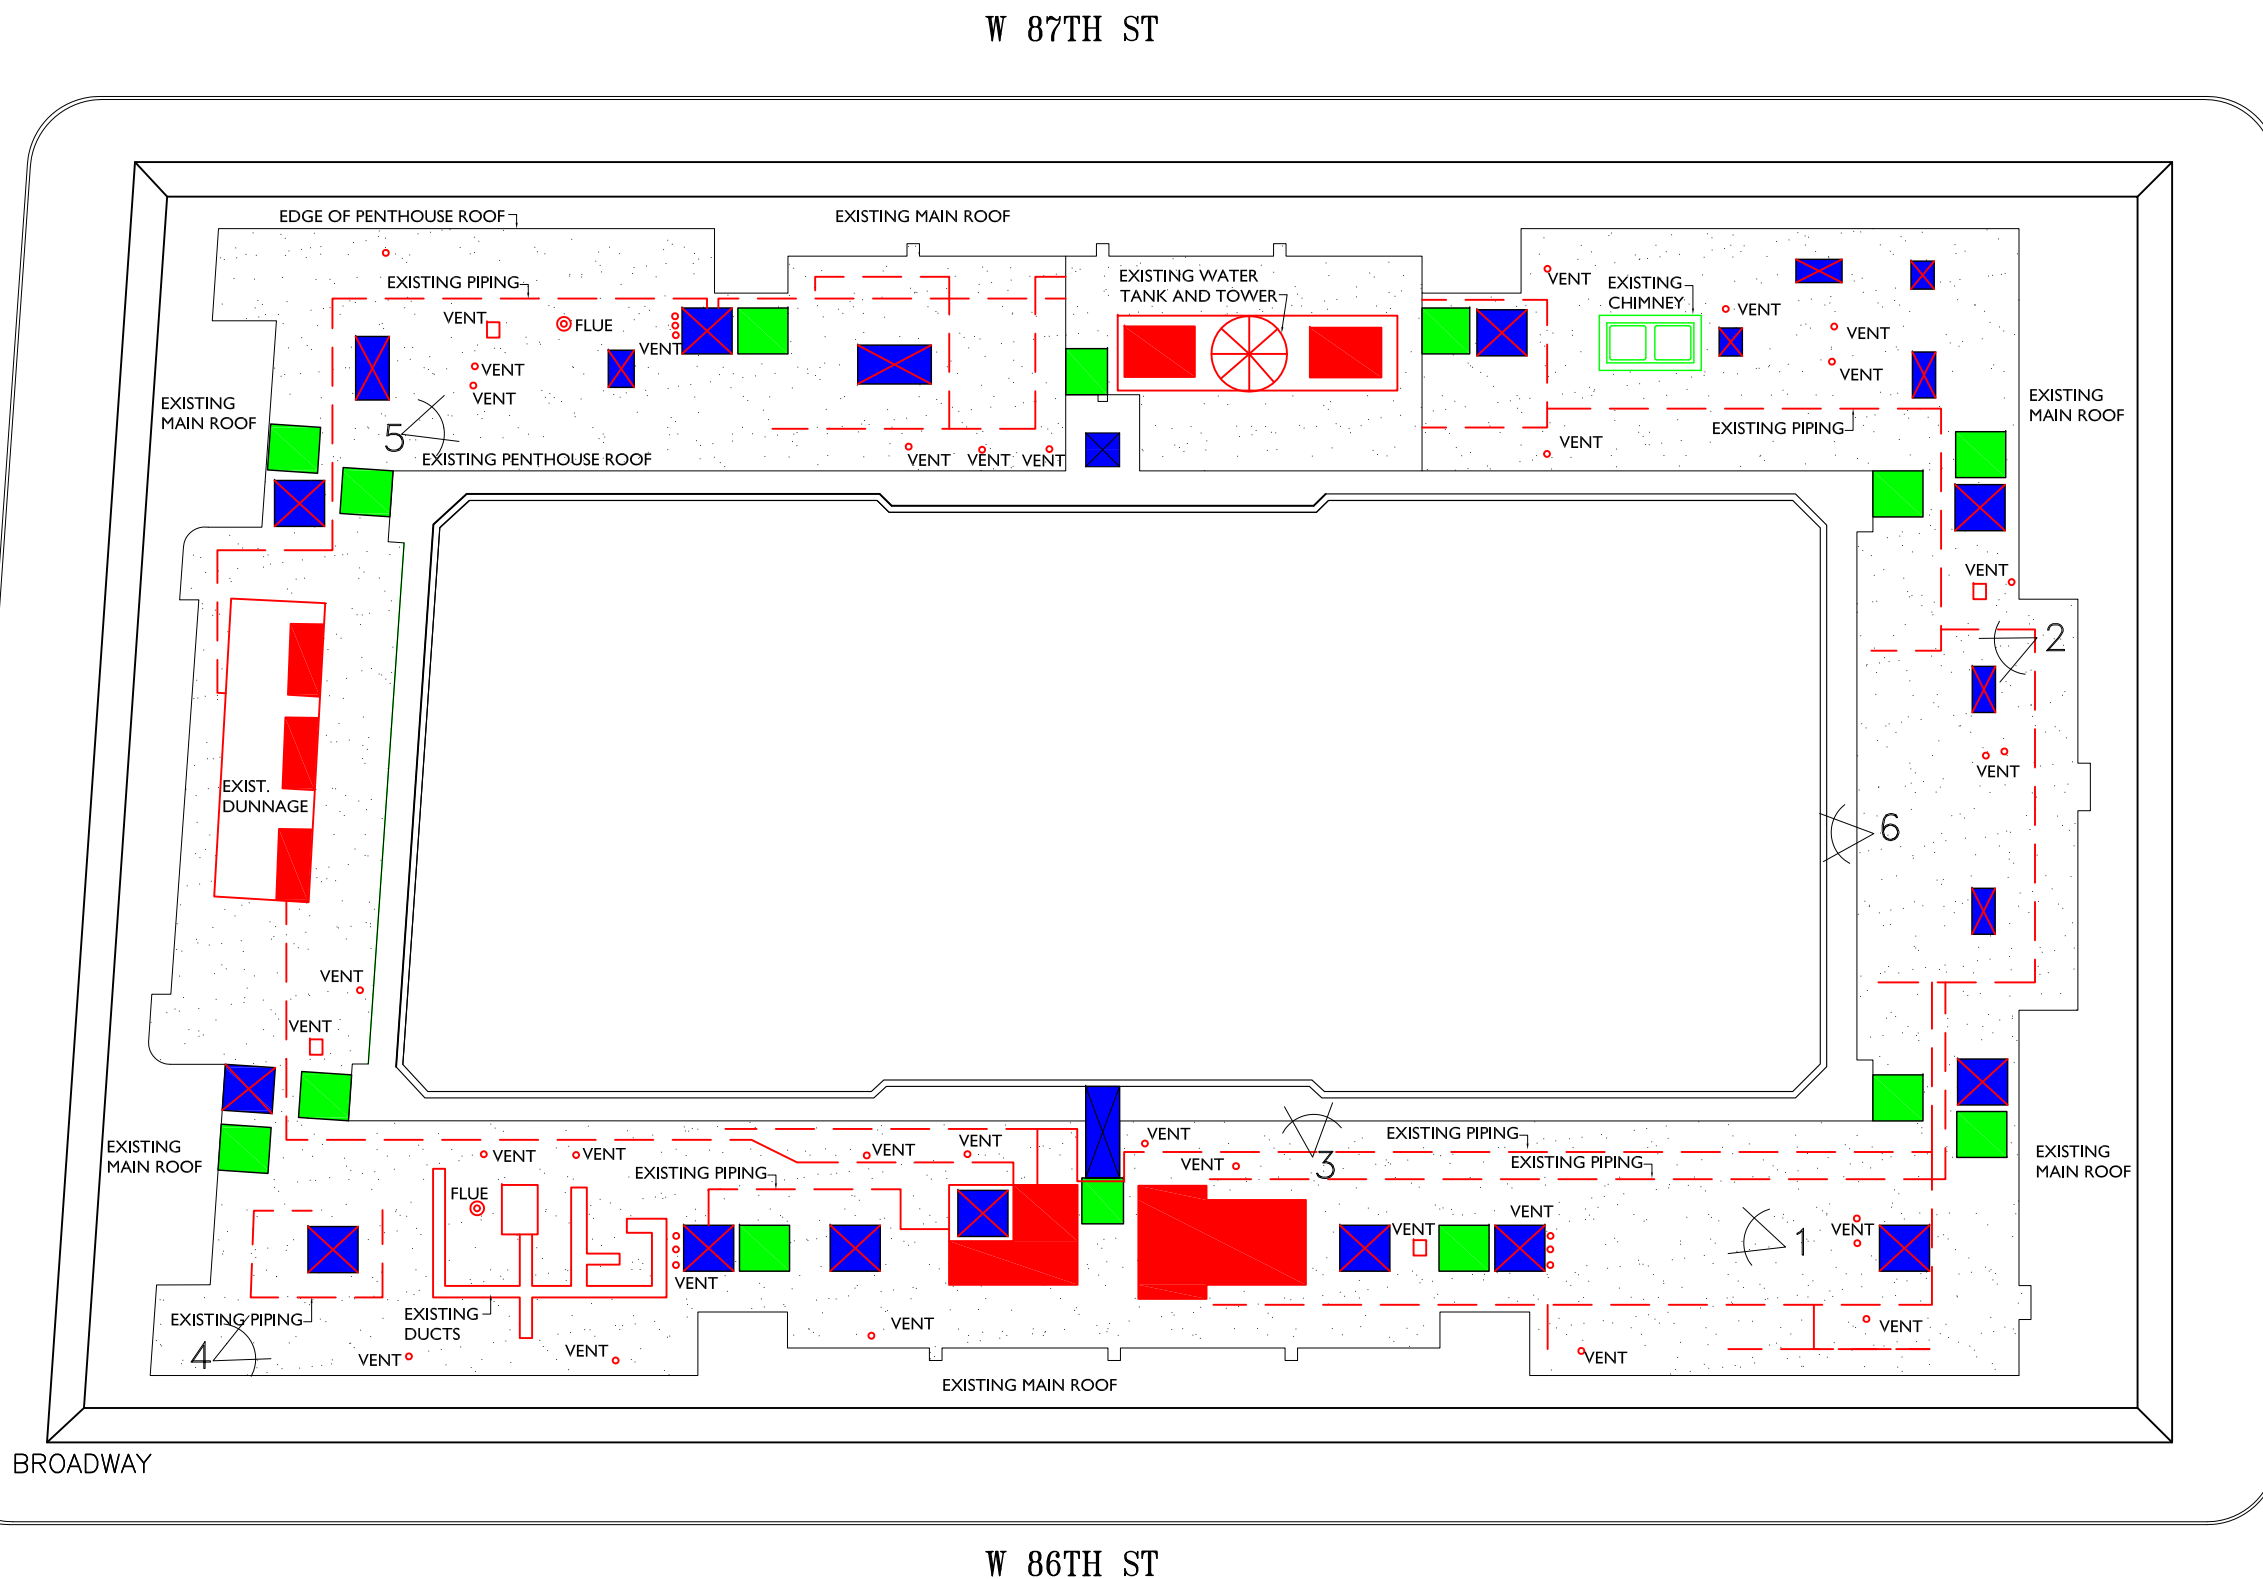

AMSTERDAM AV.

ROOF PLAN

SCALE: 1/32"= 1'0"



THE BELNORD

225 WEST 86TH STREET
NEW YORK, NEW YORK

NEW YORK CITY
LANDMARKS PRESERVATION
COMMISSION SUBMISSION

**UPPER ROOF
MECHANICAL**

MEPF Engineer
Plus Group Consulting Engineers
231 WEST 29th STREET
#706
New York, NY 10001
(212) 233-2700

EXISTING ROOF PLAN

DRAWING TITLE

DRAWN BY:	NA	SCALE:	AS NOTED
CHECKED BY:	IM	PROJ. NO.	NA
DATE		10 MARCH 2016	


DRAWING NO.

02

LEGEND

- EXISTING MECHANICAL EQUIPMENT
- PROPOSED MEP BOILER LOCATION
- PENTHOUSE ROOF
- EXISTING ELEVATOR BULKHEAD
- EXISTING SKYLIGHT
- EXISTING PIPING

BROADWAY

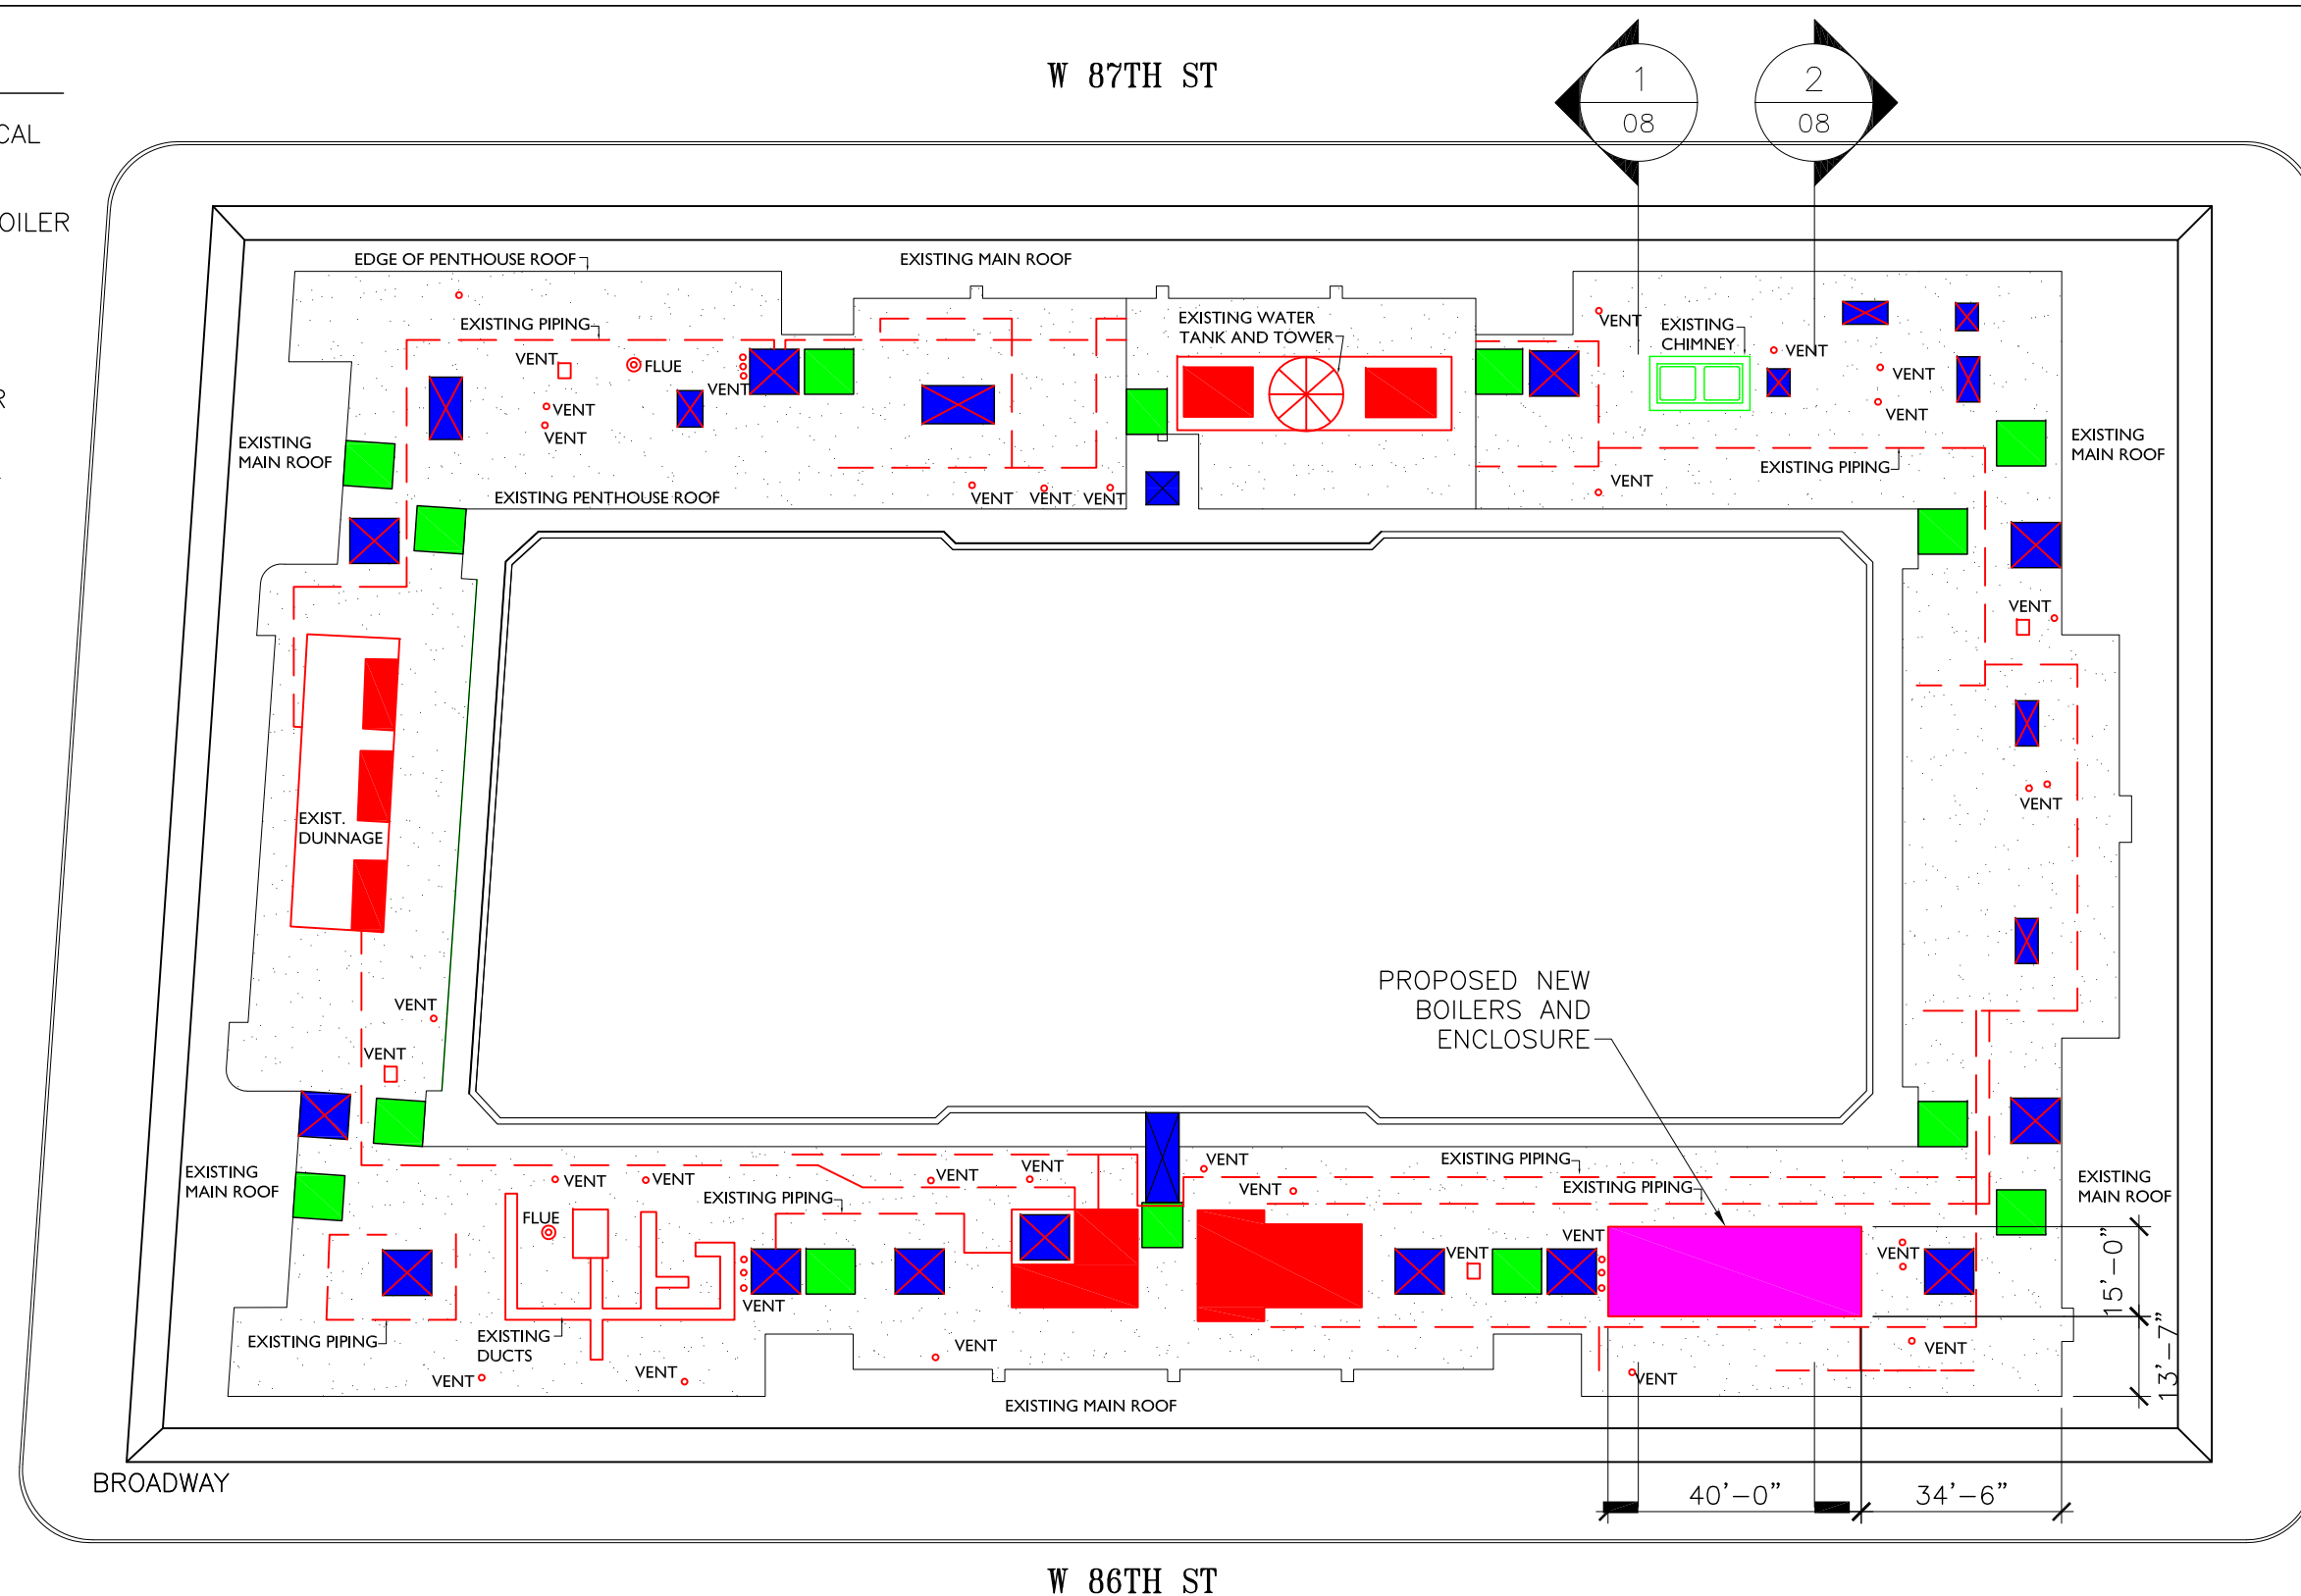

AMSTERDAM AV.

ROOF PLAN SCALE: 1/32"= 1'0"



THE BELNORD
225 WEST 86TH STREET
NEW YORK, NEW YORK

NEW YORK CITY
LANDMARKS PRESERVATION
COMMISSION SUBMISSION

**UPPER ROOF
MECHANICAL**

MEPF Engineer
Plus Group Consulting Engineers
231 WEST 29th STREET
#706
New York, NY 10001
(212) 233-2700

PROPOSED ROOF PLAN

DRAWING TITLE

DRAWN BY:	NA	SCALE:	AS NOTED
CHECKED BY:	IM	PROJ. NO.:	NA
DATE:	10 MARCH 2016		

DRAWING NO.

03



1 VIEW LOOKING WEST FROM
SOUTH ELEVATION



2 VIEW LOOKING SOUTH FROM
EAST ELEVATION



3 VIEW LOOKING NORTH FROM
SOUTH ELEVATION



4 VIEW LOOKING EAST FROM
SOUTH ELEVATION



5 VIEW LOOKING WEST FROM
NORTH ELEVATION



6 VIEW LOOKING WEST FROM
EAST ELEVATION

THE BELNORD
225 WEST 86TH STREET
NEW YORK, NEW YORK

NEW YORK CITY
LANDMARKS PRESERVATION
COMMISSION SUBMISSION

**UPPER ROOF
MECHANICAL**

MEPF Engineer
Plus Group Consulting Engineers
231 WEST 29th STREET
#706
New York, NY 10001
(212) 233-2700

**EXISTING CONDITIONS
AT ROOF**

DRAWING TITLE

DRAWN BY:	NA	SCALE:	AS NOTED
CHECKED BY:	IM	PROJ. NO.	NA
DATE		10 MARCH 2016	

04
DRAWING NO.



SOUTH ELEVATION - 86TH STREET
 SCALE: 1/32" = 1'-0"

THE BELNORD
 225 WEST 86TH STREET
 NEW YORK, NEW YORK

NEW YORK CITY
 LANDMARKS PRESERVATION
 COMMISSION SUBMISSION

**UPPER ROOF
 MECHANICAL**


MEPF Engineer
 Plus Group Consulting Engineers
 231 WEST 29th STREET
 #706
 New York, NY 10001
 (212) 233-2700

EXISTING ELEVATION

DRAWING TITLE

DRAWN BY:	NA	SCALE:	AS NOTED
CHECKED BY:	IM	PROJ. NO.	NA
DATE	10 MARCH 2016		

05
 DRAWING NO.

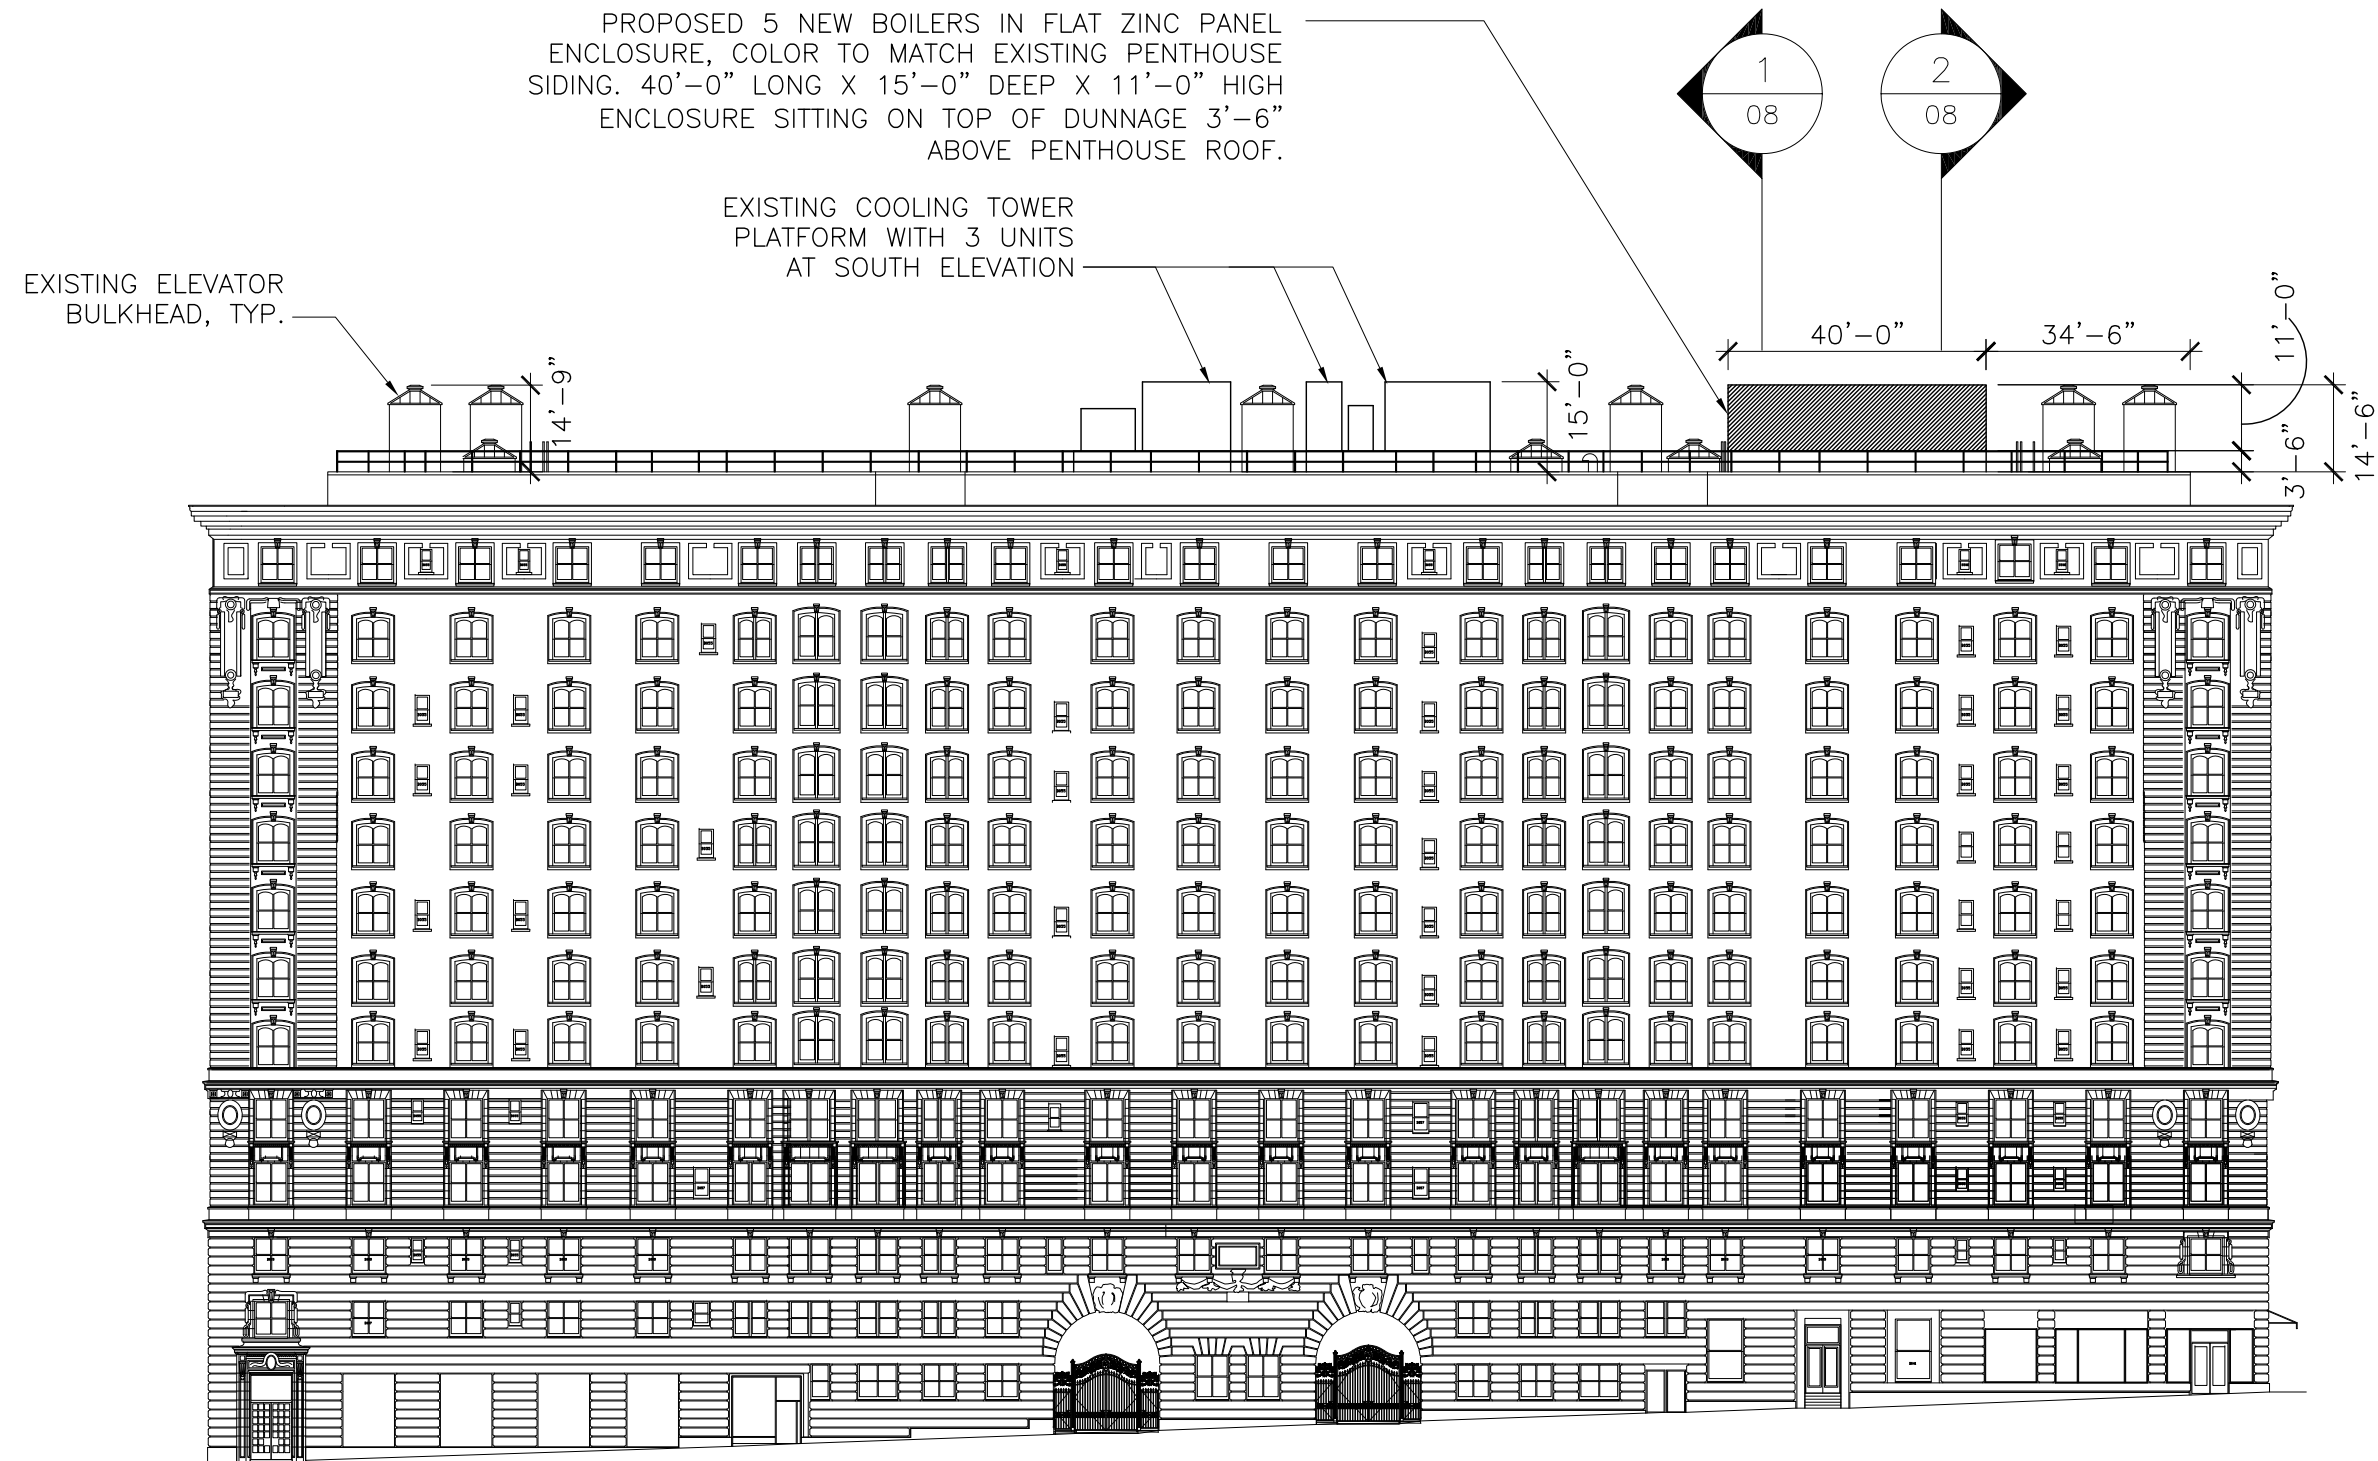

SOUTH ELEVATION - 86TH STREET
 SCALE: 1/32" = 1'-0"

THE BELNORD
 225 WEST 86TH STREET
 NEW YORK, NEW YORK

NEW YORK CITY
 LANDMARKS PRESERVATION
 COMMISSION SUBMISSION

**UPPER ROOF
 MECHANICAL**


MEPF Engineer
 Plus Group Consulting Engineers
 231 WEST 29th STREET
 #706
 New York, NY 10001
 (212) 233-2700

PROPOSED ELEVATION


DRAWING TITLE

DRAWN BY:	NA	SCALE:	AS NOTED
CHECKED BY:	IM	PROJ. NO.	NA
DATE	10 MARCH 2016		

06
 DRAWING NO.

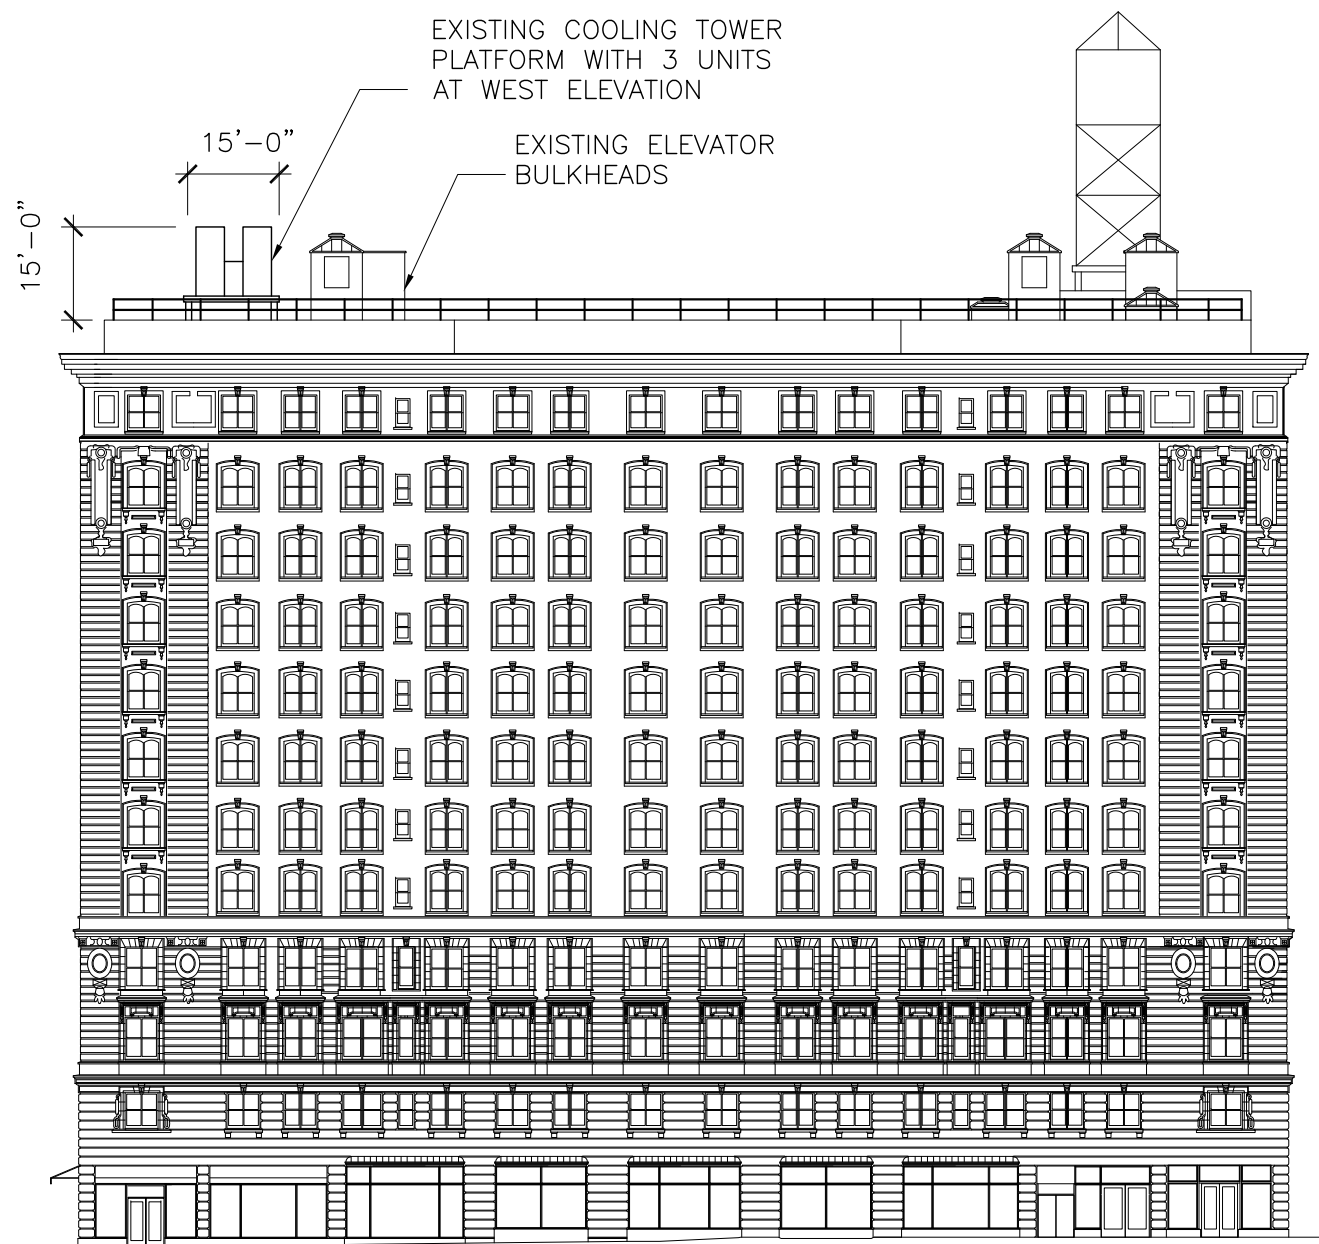

EXISTING EAST ELEVATION - AMSTERDAM
SCALE: 1/32" = 1'-0"

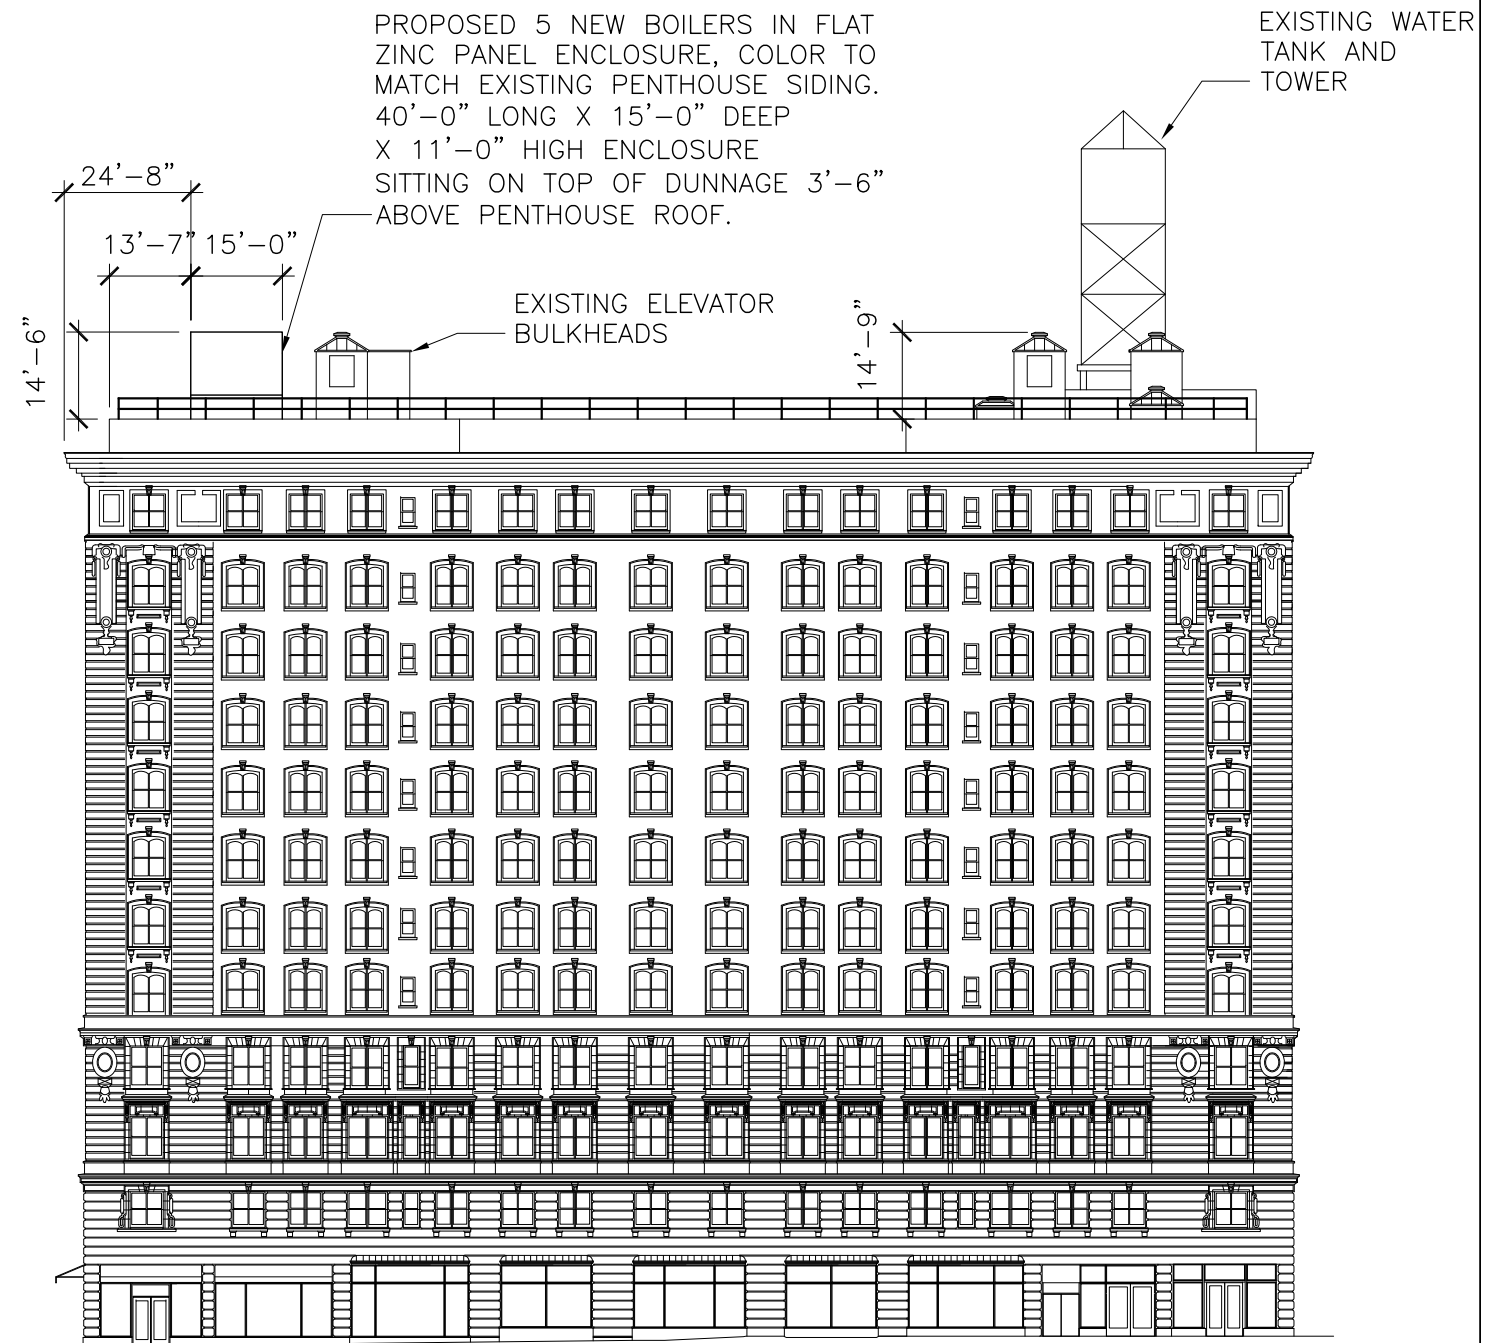

PROPOSED EAST ELEVATION - AMSTERDAM
SCALE: 1/32" = 1'-0"

THE BELNORD
225 WEST 86TH STREET
NEW YORK, NEW YORK

NEW YORK CITY
LANDMARKS PRESERVATION
COMMISSION SUBMISSION

**UPPER ROOF
MECHANICAL**


MEPF Engineer
Plus Group Consulting Engineers
231 WEST 29th STREET
#706
New York, NY 10001
(212) 233-2700

**EXISTING AND
PROPOSED ELEVATIONS**


DRAWING TITLE

DRAWN BY:	SCALE:
NA	AS NOTED
CHECKED BY:	PROJ. NO.
IM	NA
10 MARCH 2016	
DATE	DRAWING NO.

07

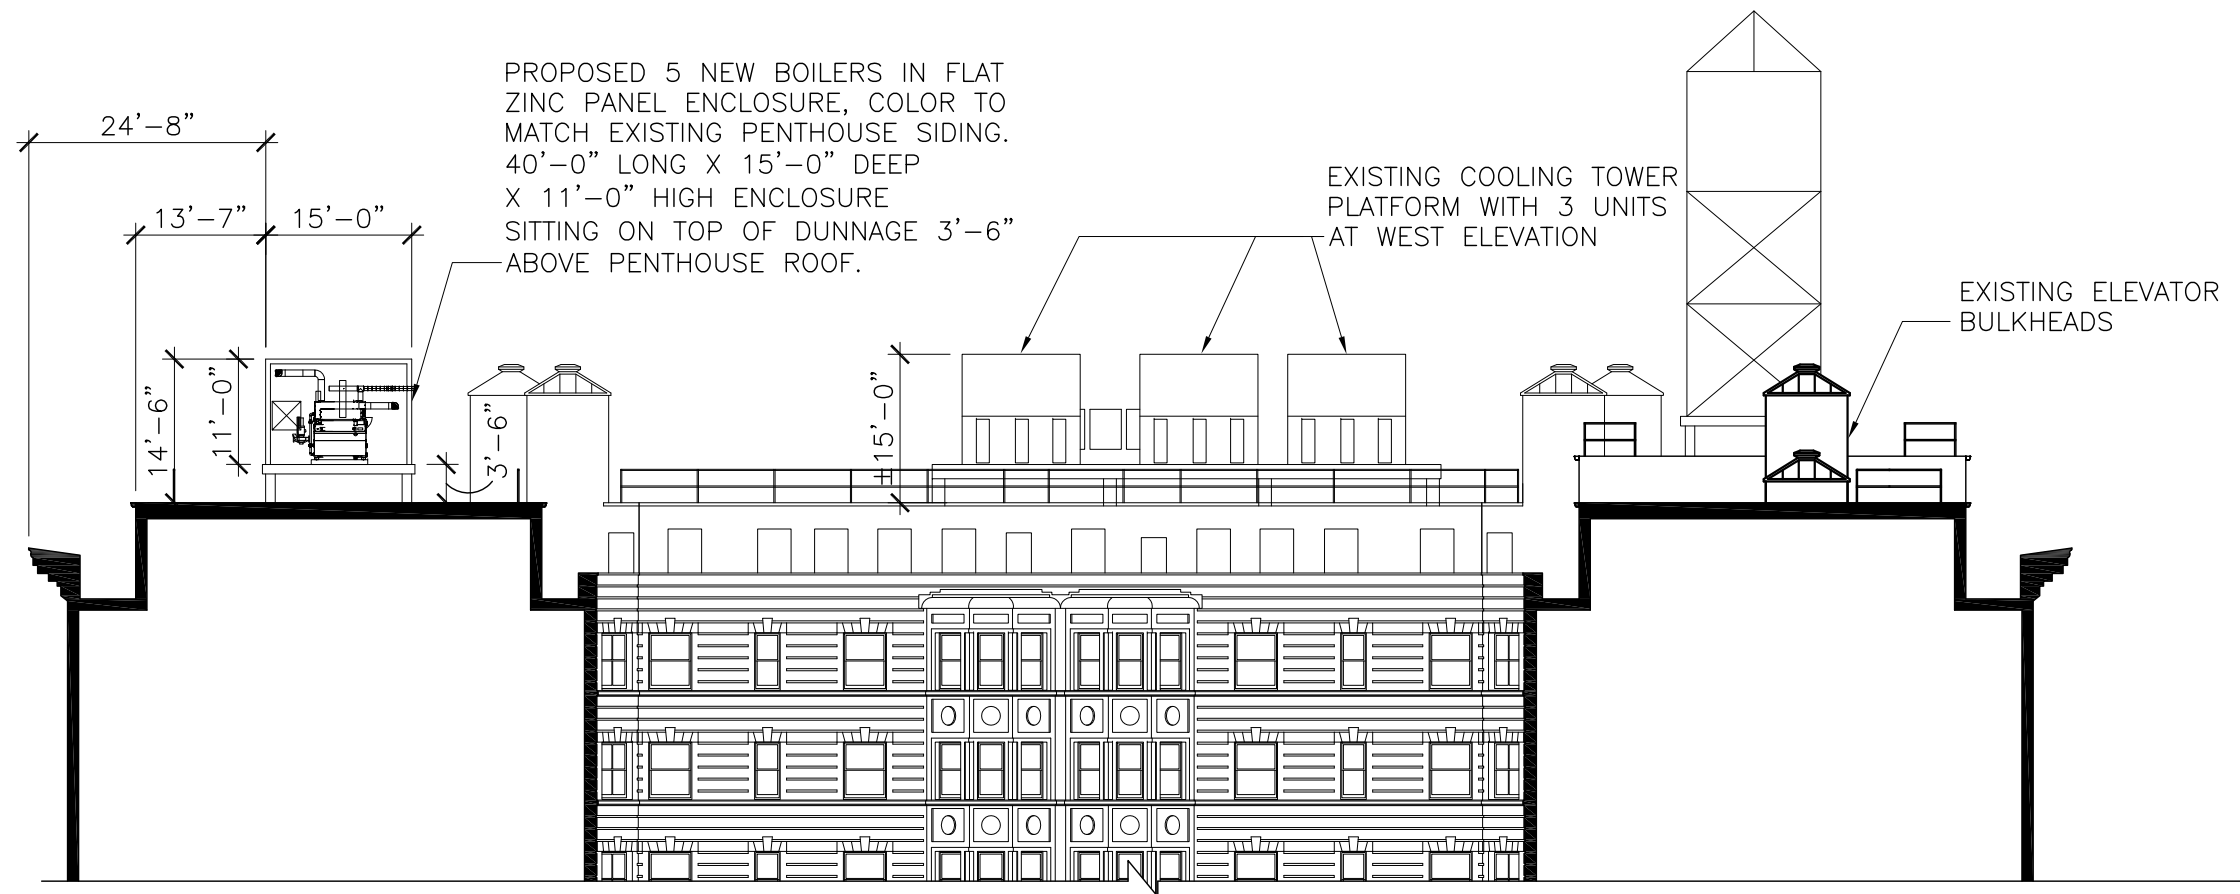

1 SECTION LOOKING WEST
SCALE: N.T.S.

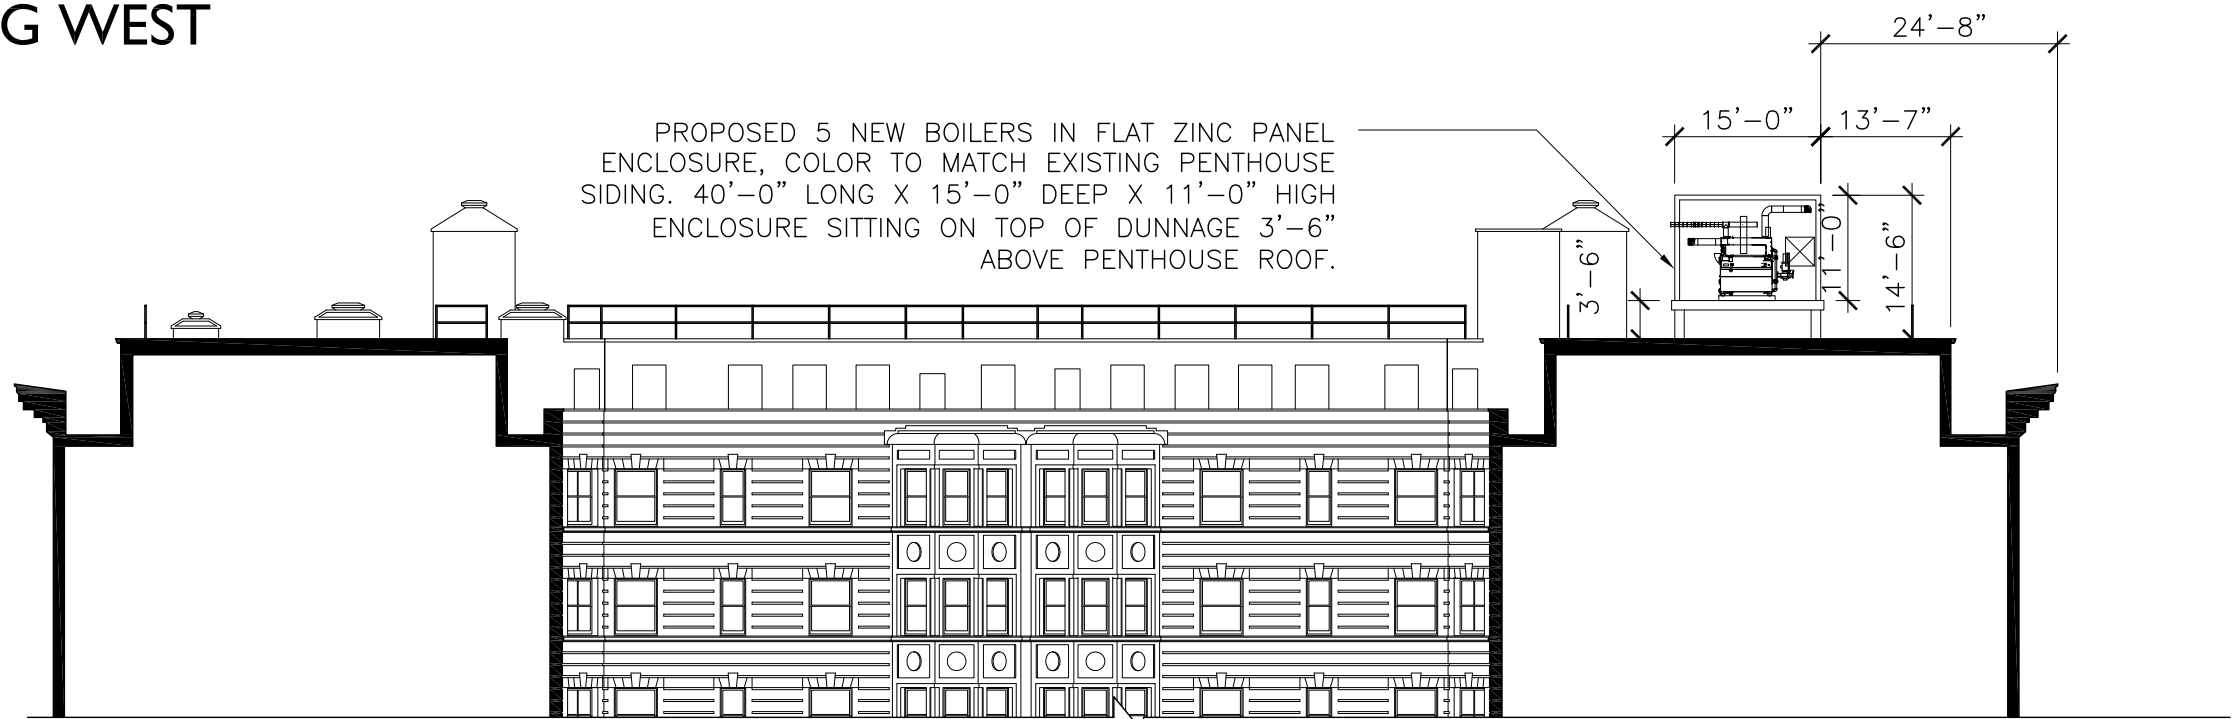

2 SECTION LOOKING EAST
SCALE: N.T.S.

THE BELNORD
225 WEST 86TH STREET
NEW YORK, NEW YORK

NEW YORK CITY
LANDMARKS PRESERVATION
COMMISSION SUBMISSION

**UPPER ROOF
MECHANICAL**

MEPF Engineer
Plus Group Consulting Engineers
231 WEST 29th STREET
#706
New York, NY 10001
(212) 233-2700


PROPOSED SECTIONS

DRAWING TITLE

DRAWN BY:	SCALE:
NA	AS NOTED
CHECKED BY:	PROJ. NO.
IM	NA
10 MARCH 2016	
DATE	DRAWING NO.

08

PROPOSED 5 NEW BOILERS IN FLAT ZINC PANEL ENCLOSURE, COLOR TO MATCH EXISTING PENTHOUSE SIDING. 40'-0" LONG X 15'-0" DEEP X 11'-0" HIGH ENCLOSURE SITTING ON TOP OF DUNNAGE 3'-6" ABOVE PENTHOUSE ROOF.

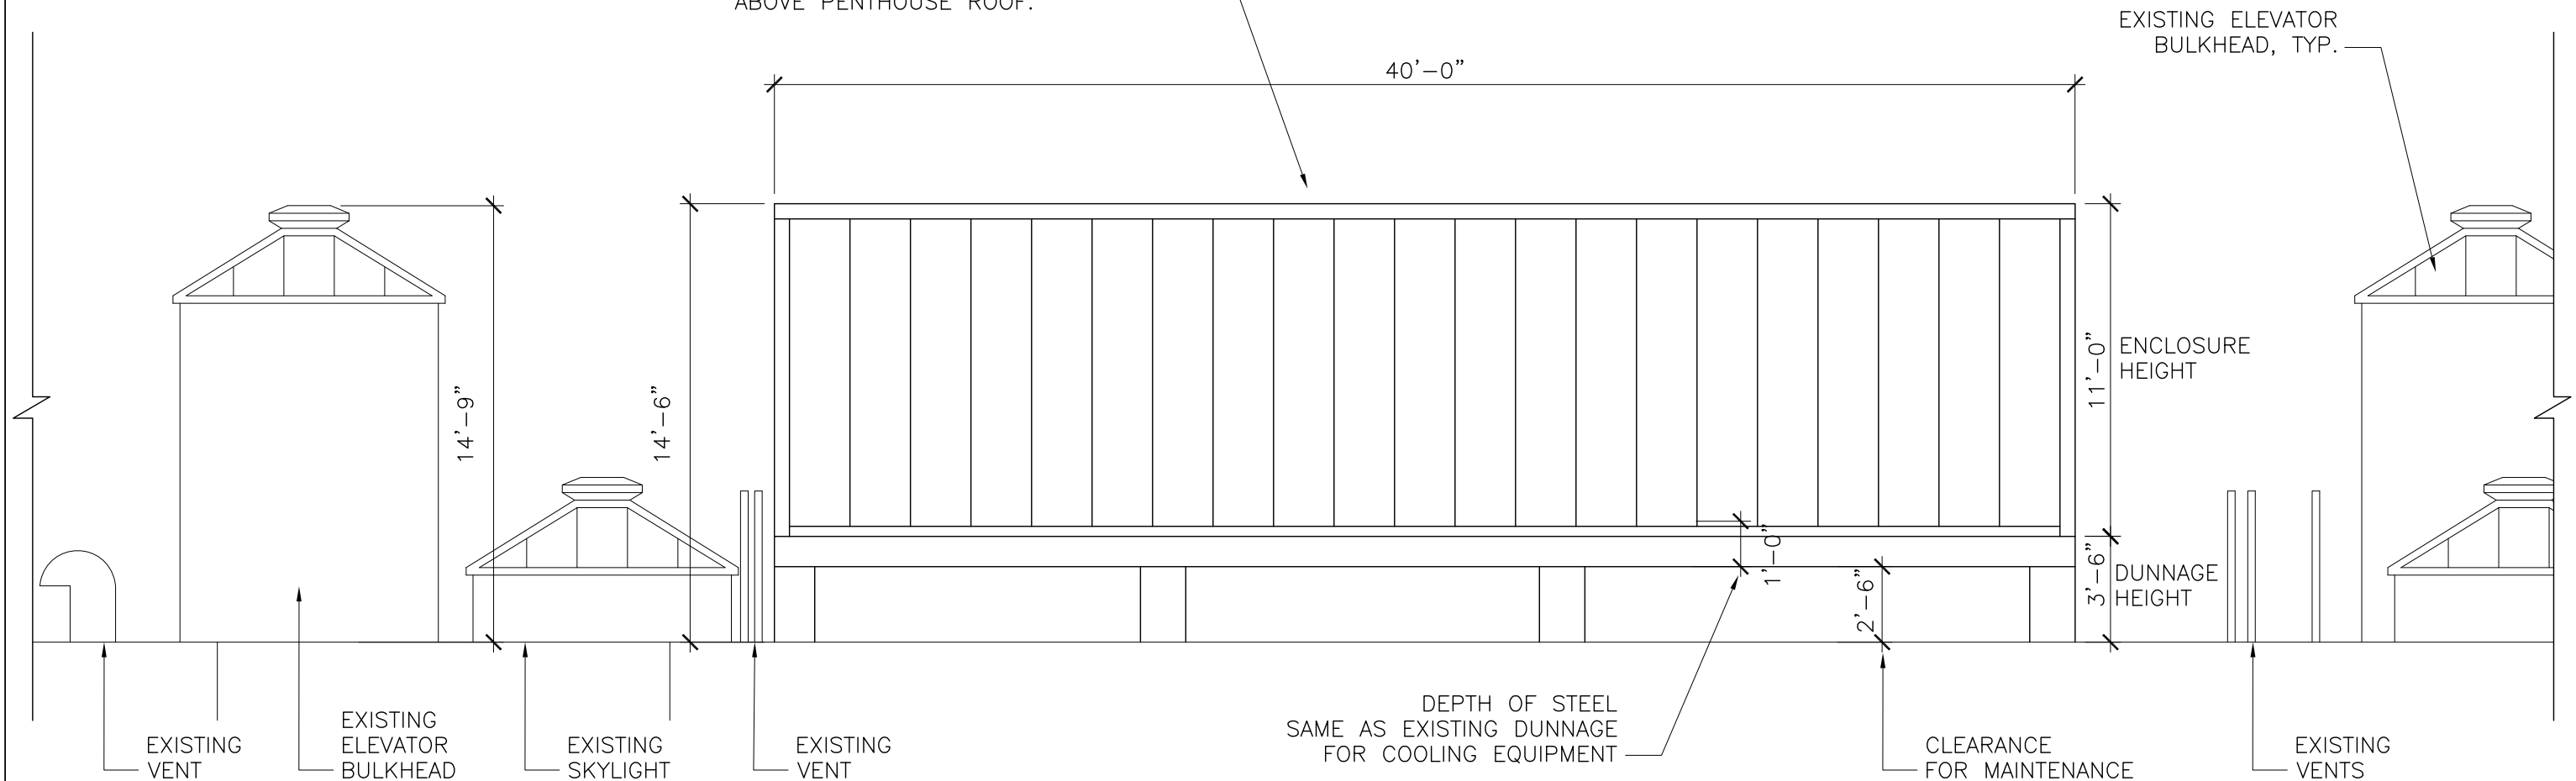

I SOUTH ELEVATION
SCALE: 3/16" = 1'-0"

THE BELNORD
225 WEST 86TH STREET
NEW YORK, NEW YORK

NEW YORK CITY
LANDMARKS PRESERVATION
COMMISSION SUBMISSION

**UPPER ROOF
MECHANICAL**

MEPF Engineer
Plus Group Consulting Engineers
231 WEST 29th STREET
#706
New York, NY 10001
(212) 233-2700


PROPOSED ELEVATION





DRAWING TITLE

DRAWN BY:	NA	SCALE:	AS NOTED
CHECKED BY:	IM	PROJ. NO.	NA
DATE	10 MARCH 2016		

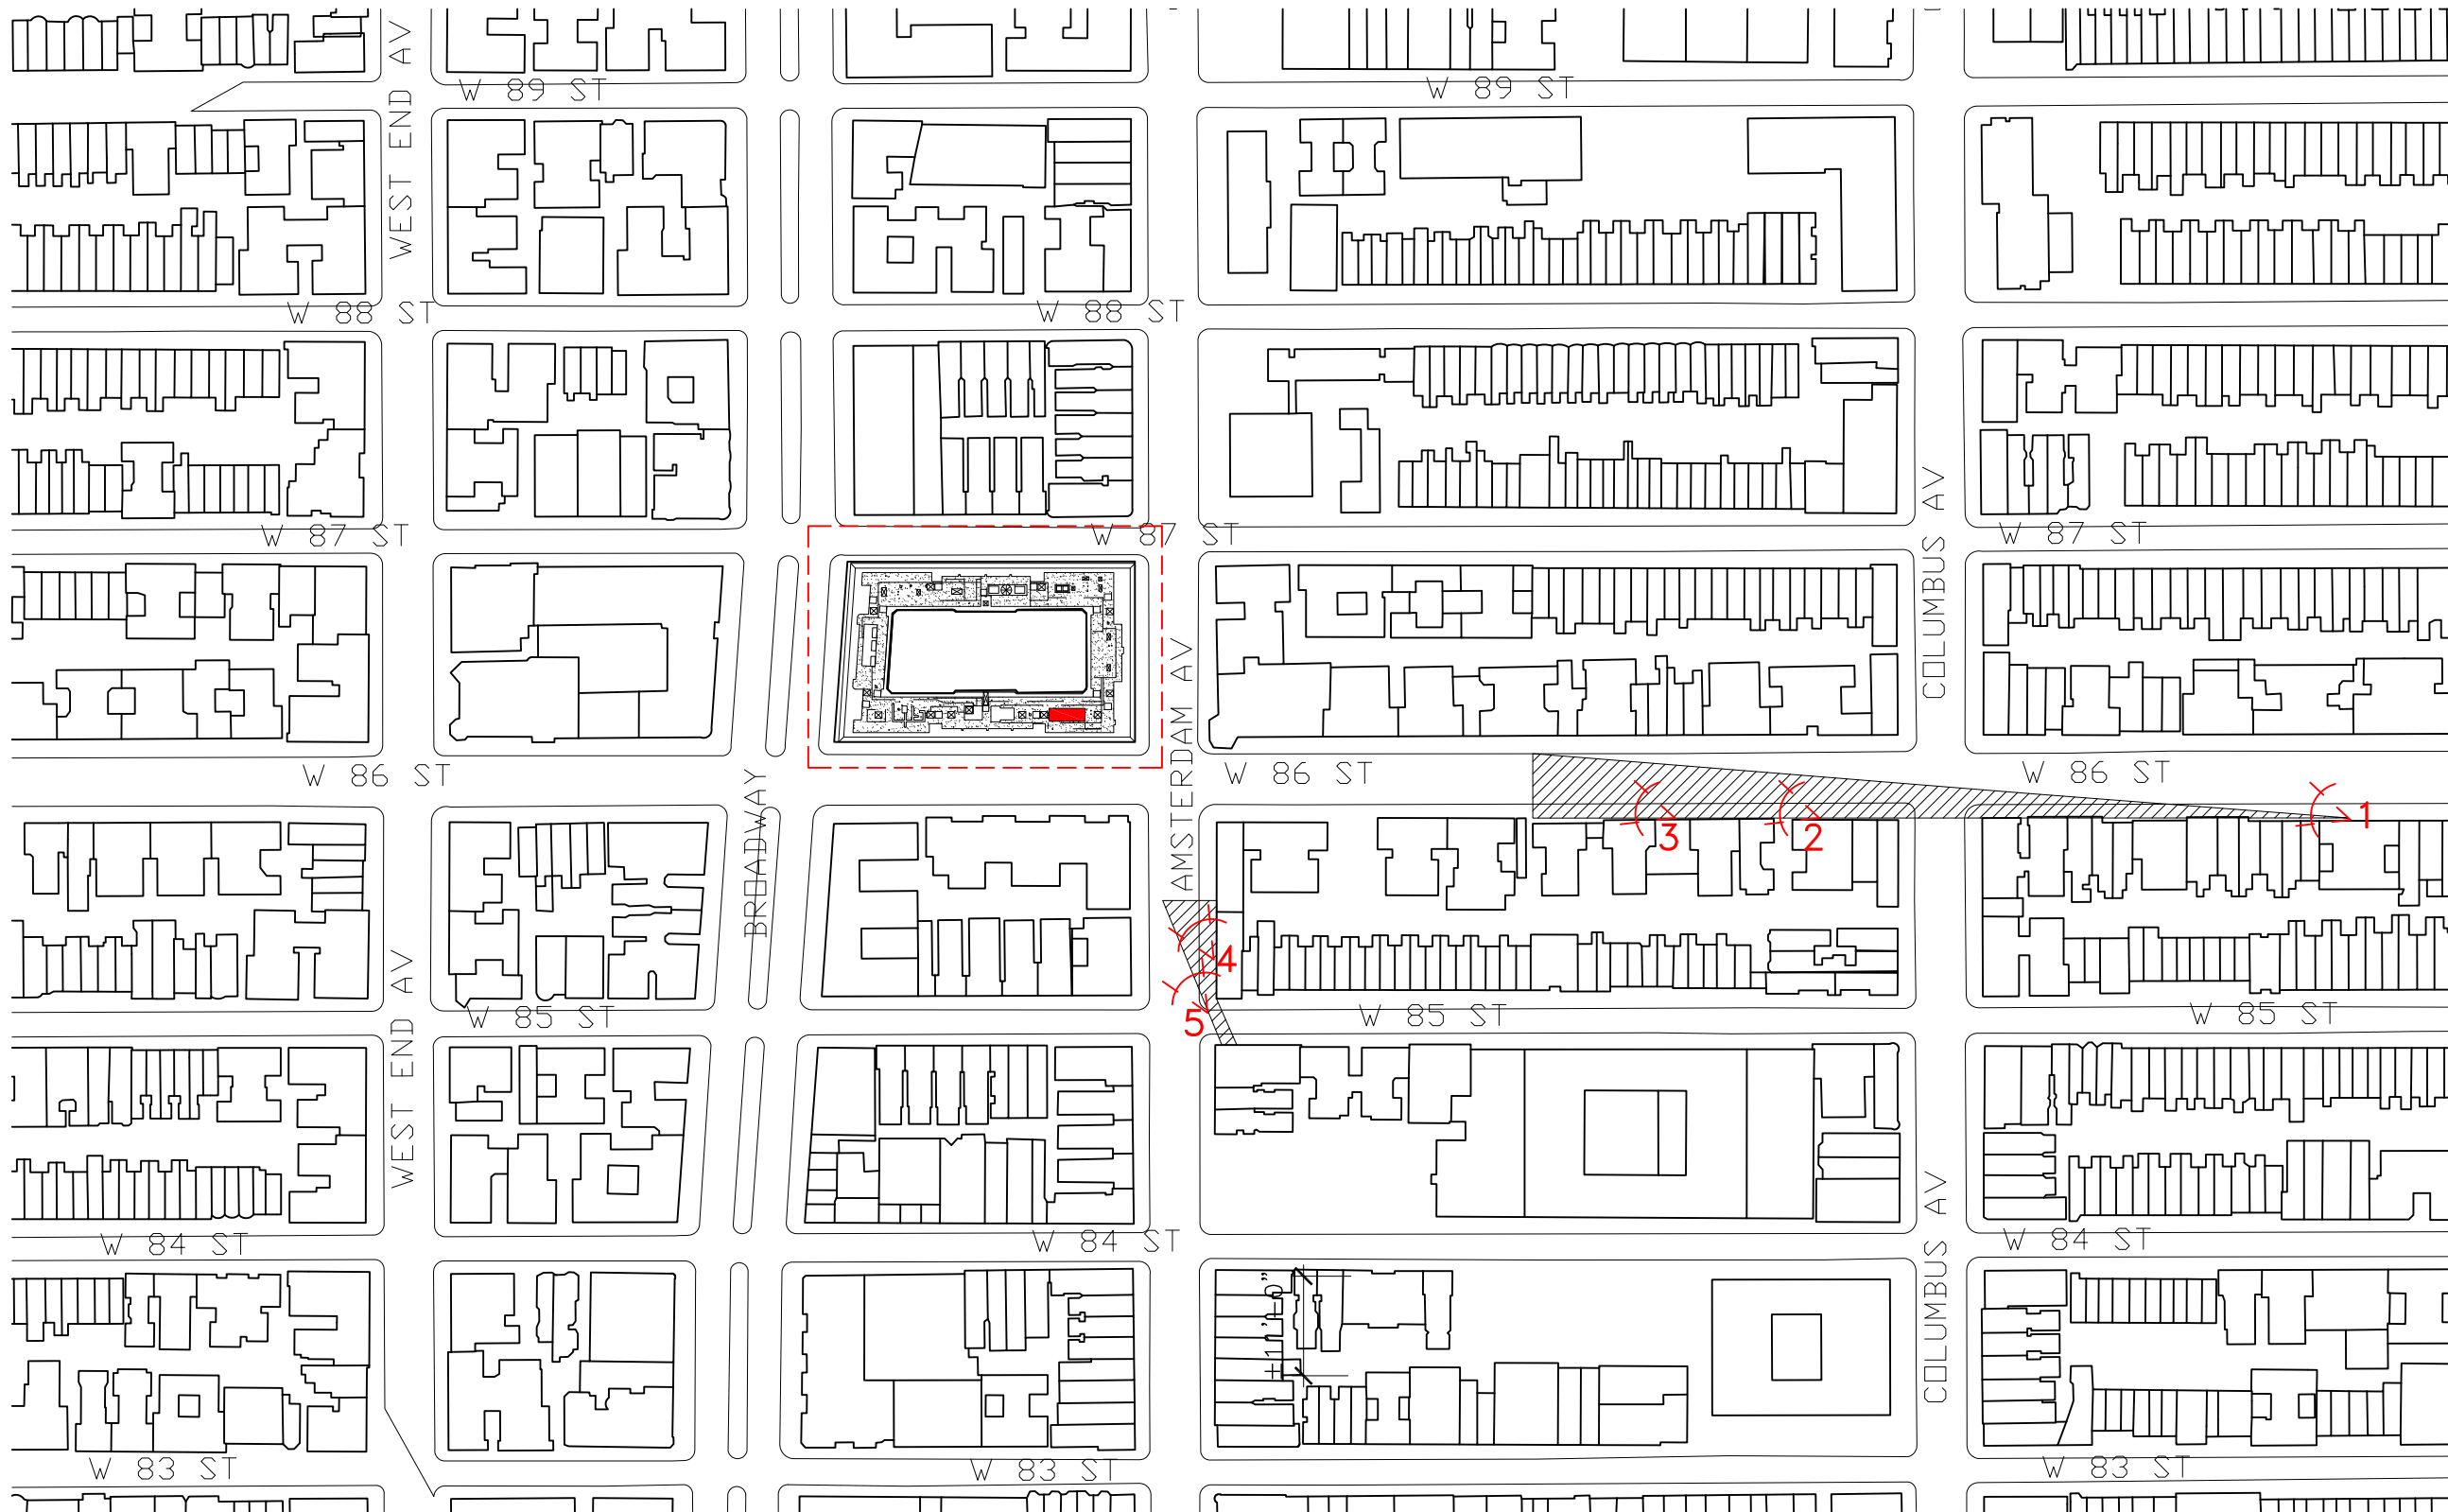09
DRAWING NO.





- LEGEND
-  MEP BOILER
 -  AREA OF VISIBILITY
 -  THE BELNORD
 -  PHOTOGRAPH KEY FOR SHEET 13, 14, AND 15

SITE PLAN
SCALE: NOT TO SCALE



THE BELNORD
225 WEST 86TH STREET
NEW YORK, NEW YORK

NEW YORK CITY
LANDMARKS PRESERVATION
COMMISSION SUBMISSION

**UPPER ROOF
MECHANICAL**

MEPF Engineer
Plus Group Consulting Engineers
231 WEST 29th STREET
#706
New York, NY 10001
(212) 233-2700

**VISIBILITY DIAGRAM
PHOTOGRAPH KEY PLAN**
DRAWING TITLE

DRAWN BY:	NA	SCALE:	AS NOTED
CHECKED BY:	IM	PROJ. NO.:	NA
DATE:	10 MARCH 2016		DRAWING NO.

12

EXISTING MOCK-UP



I VIEW LOOKING WEST FROM 86TH ST
EXISTING VIEW @ ±1,450'-0"

PROPOSED
PHOTOMONTAGE



IA VIEW LOOKING WEST FROM 86TH ST
PROPOSED VIEW @ ±1,450'-0"

EXISTING MOCK-UP



2 VIEW LOOKING WEST FROM 86TH ST
EXISTING VIEW @ ±800'-0"

PROPOSED
PHOTOMONTAGE



2A VIEW LOOKING WEST FROM 86TH ST
PROPOSED VIEW @ ±800'-0"

THE BELNORD
225 WEST 86TH STREET
NEW YORK, NEW YORK

NEW YORK CITY
LANDMARKS PRESERVATION
COMMISSION SUBMISSION

**UPPER ROOF
MECHANICAL**

MEPF Engineer
Plus Group Consulting Engineers
231 WEST 29th STREET
#706
New York, NY 10001
(212) 233-2700

DRAWING TITLE

**EAST FACADE
PHOTOGRAPHS**

DRAWN BY:	NA	SCALE:	AS NOTED
CHECKED BY:	IM	PROJ. NO.	NA
DATE	10 MARCH 2016		

13
DRAWING NO.

EXISTING MOCK-UP



3 VIEW LOOKING WEST FROM 86TH ST
EXISTING VIEW @ ±650'-0"

PROPOSED
PHOTOMONTAGE



3A VIEW LOOKING WEST FROM 86TH ST
PROPOSED VIEW @ ±650'-0"

THE BELNORD
225 WEST 86TH STREET
NEW YORK, NEW YORK

NEW YORK CITY
LANDMARKS PRESERVATION
COMMISSION SUBMISSION

**UPPER ROOF
MECHANICAL**

MEPF Engineer
Plus Group Consulting Engineers
231 WEST 29th STREET
#706
New York, NY 10001
(212) 233-2700

DRAWING TITLE

**EAST FACADE
PHOTOGRAPHS**

DRAWN BY:	NA	SCALE:	AS NOTED
CHECKED BY:	IM	PROJ. NO.	NA
DATE	10 MARCH 2016		

14
DRAWING NO.



EXISTING
MOCK-UP

4 VIEW LOOKING NORTH FROM AMSTERDAM AVENUE
EXISTING VIEW @ ±260'-0"



PROPOSED
PHOTOMONTAGE

4A VIEW LOOKING NORTH FROM AMSTERDAM AVENUE
PROPOSED VIEW @ ±260'-0"




EXISTING
MOCK-UP

5 VIEW LOOKING NORTH FROM AMSTERDAM AVENUE
EXISTING VIEW @ ±315'-0"




PROPOSED
PHOTOMONTAGE

5A VIEW LOOKING NORTH FROM AMSTERDAM AVENUE
PROPOSED VIEW @ ±315'-0"

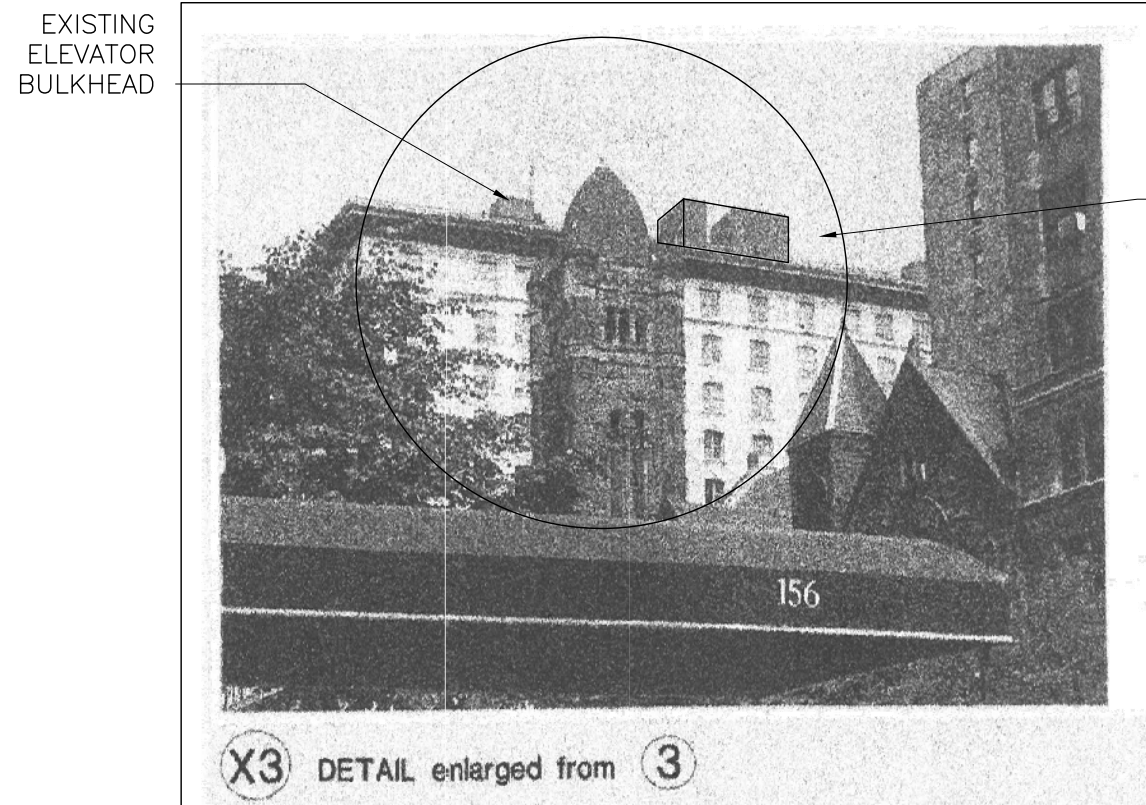


A 2004 VIEW OF PROPOSED MEP EQUIPMENT FROM 86TH STREET BETWEEN AMSTERDAM AND COLUMBUS

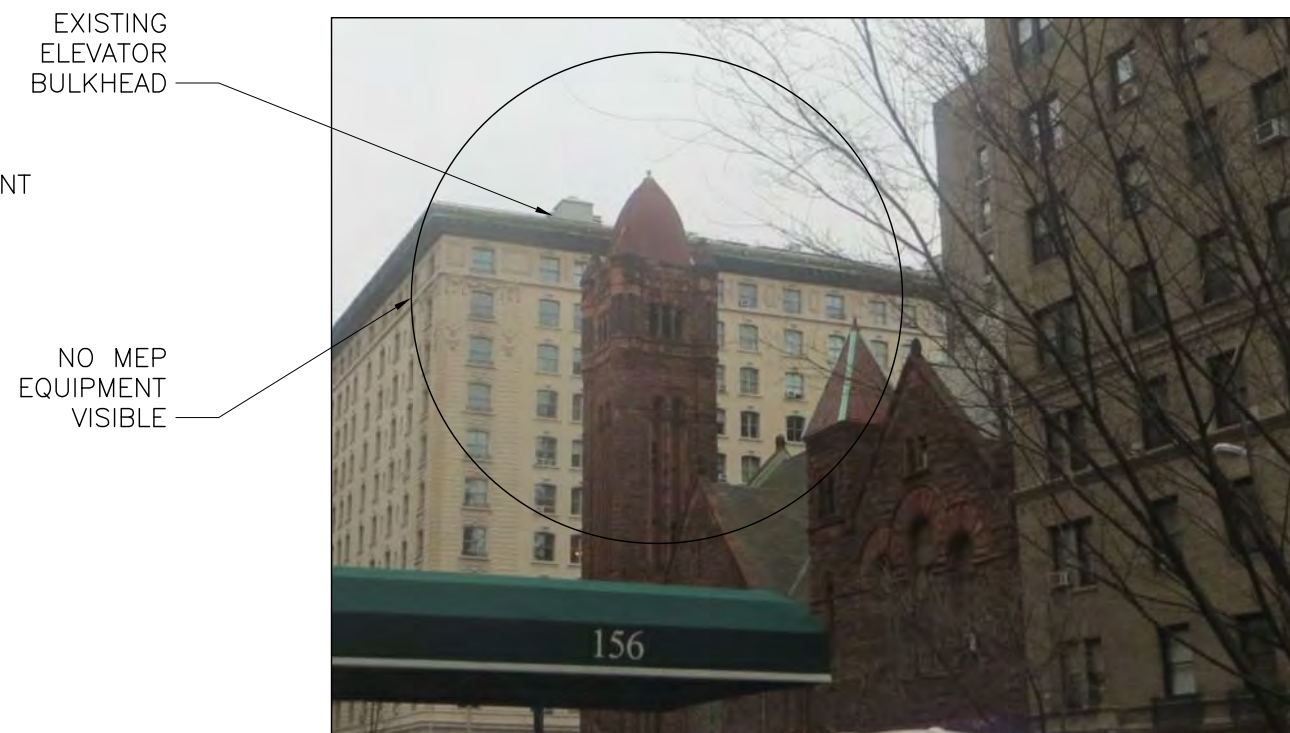


B 2016 COMPARABLE TO 2004 VIEW OF PROPOSED MEP EQUIPMENT FROM 86TH STREET BETWEEN AMSTERDAM AND COLUMBUS

COMPARISON OF VISIBILITY BETWEEN PROPOSED 2004 EQUIPMENT AND 2016 EQUIPMENT FROM 86TH STREET LOOKING WEST

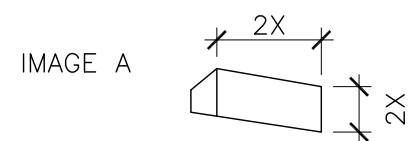



2004 PROPOSED MEP EQUIPMENT VISIBLE FROM CLOSE AND WITHIN CONTEXT OF CHURCH. 2016 PROPOSAL NOT VISIBLE FROM THIS SAME LOCATION (IMAGE B).

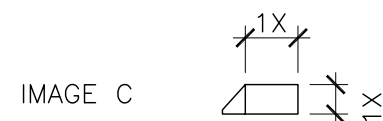

2016 PROPOSED MEP EQUIPMENT VISIBLE FROM FAR AND HALF THE SIZE OF THE 2004 PROPOSAL AND NOT WITHIN CONTEXT OF CHURCH




C 2016 VIEW OF GREATEST VISIBILITY ENLARGED TO COMPARE WITH SAME SIZE AS 2004 VIEW (IMAGE A) BUT FROM A FARTHER DISTANCE

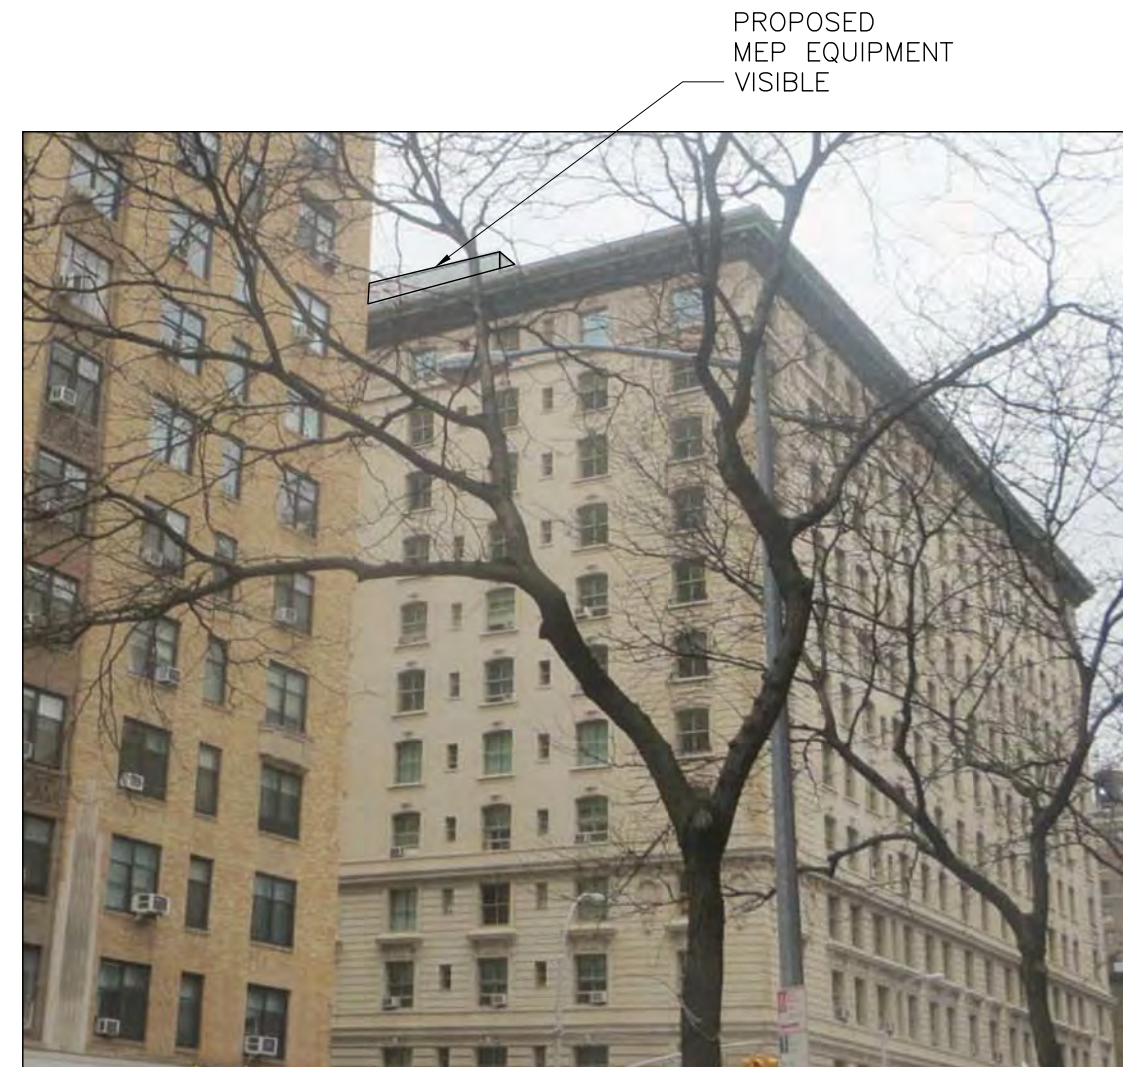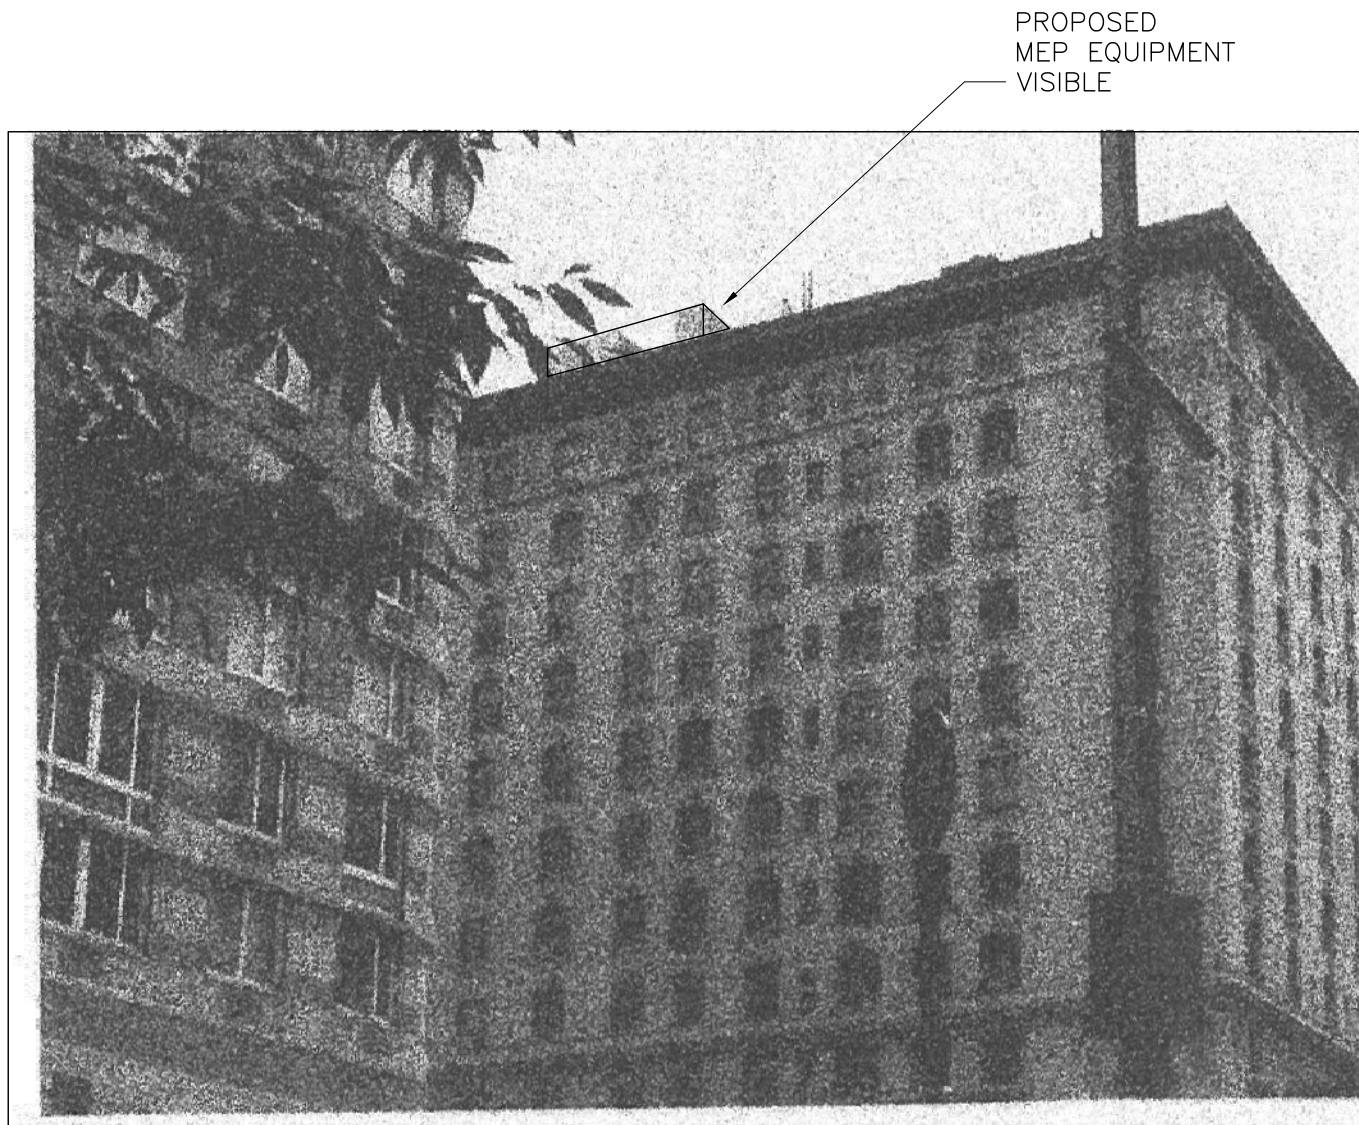


D 2004 VIEW OF PROPOSED MEP EQUIPMENT FROM 86TH STREET BETWEEN BROADWAY AND WEST END

E 2016 VIEW OF GREATEST VISIBILITY ENLARGED TO COMPARE WITH SAME SIZE AS 2004 VIEW (IMAGE A) BUT FROM AMSTERDAM BETWEEN 86TH STREET AND 85TH STREET


COMPARISON OF VISIBILITY BETWEEN PROPOSED 2004 EQUIPMENT AND 2016 EQUIPMENT FROM 86TH STREET LOOKING WEST

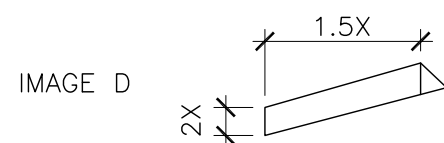

2004 PROPOSED MEP EQUIPMENT VISIBLE FROM CLOSE ON BROADWAY

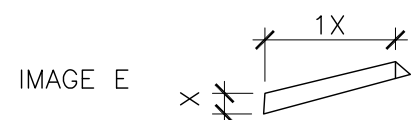

2016 PROPOSED MEP EQUIPMENT VISIBLE FROM HALF BLOCK SOUTH AND SMALLER THAN THE 2004 PROPOSAL FROM HALF BLOCK WEST

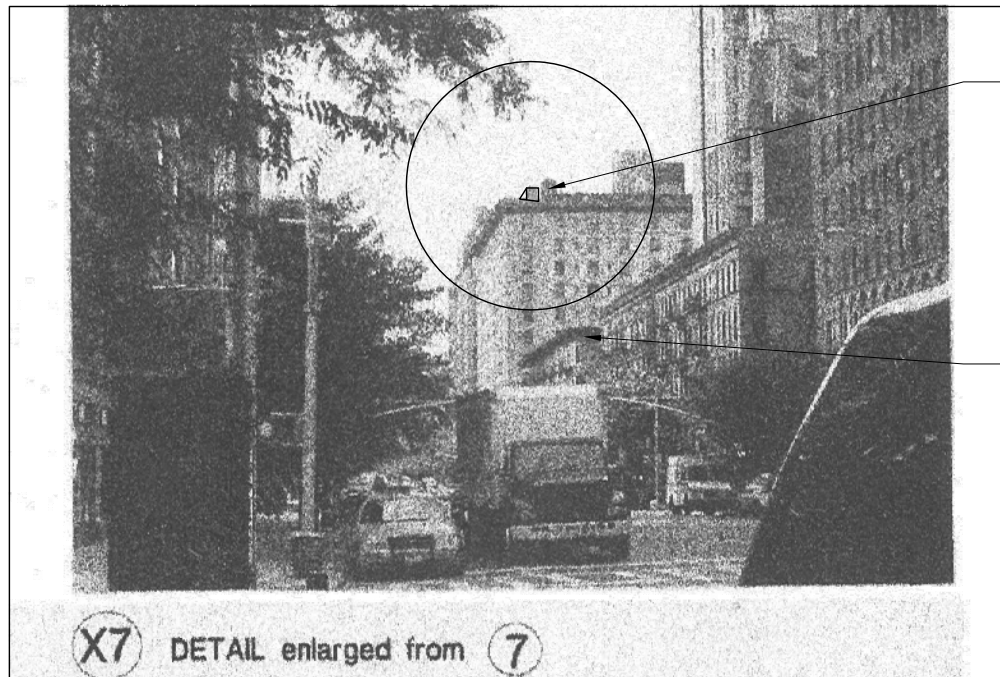

PROPOSED
MEP EQUIPMENT
VISIBLE

NOTE LOW RISE BUILDINGS
PROVIDING NO COVER
FOR MEP EQUIPMENT

X7 DETAIL enlarged from **7**

NO MEP
EQUIPMENT
VISIBLE



C 2016 VIEW OF PROPOSED MEP EQUIPMENT
LOOKING NORTH AMSTERDAM AND 85TH ST





PROPOSED
MEP EQUIPMENT
VISIBLE


X8 DETAIL enlarged from **8**

B 2004 VIEW OF PROPOSED MEP EQUIPMENT
LOOKING SOUTH FROM BROADWAY AND 90TH ST


COMPARABLE VIEWS FROM EAST AND WEST THOROUGHFARES
AT ONE STREET AWAY OR GREATER

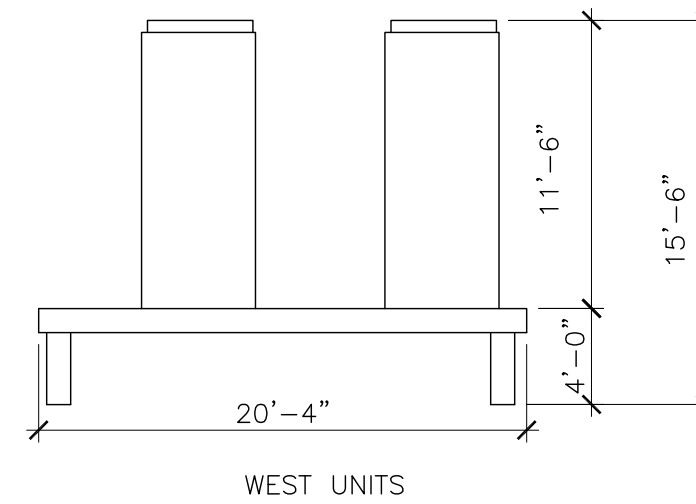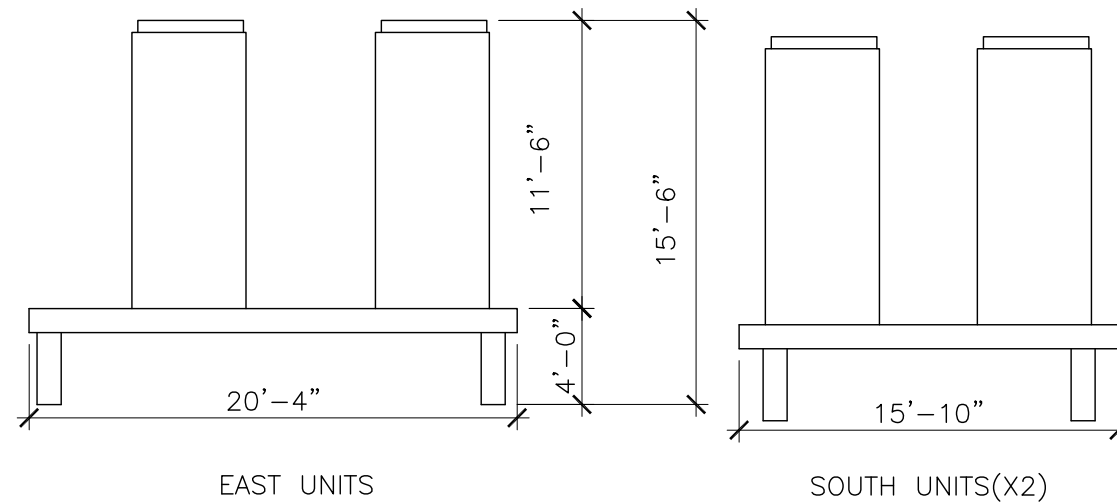

2004 PROPOSED MEP EQUIPMENT – NOT APPROVED

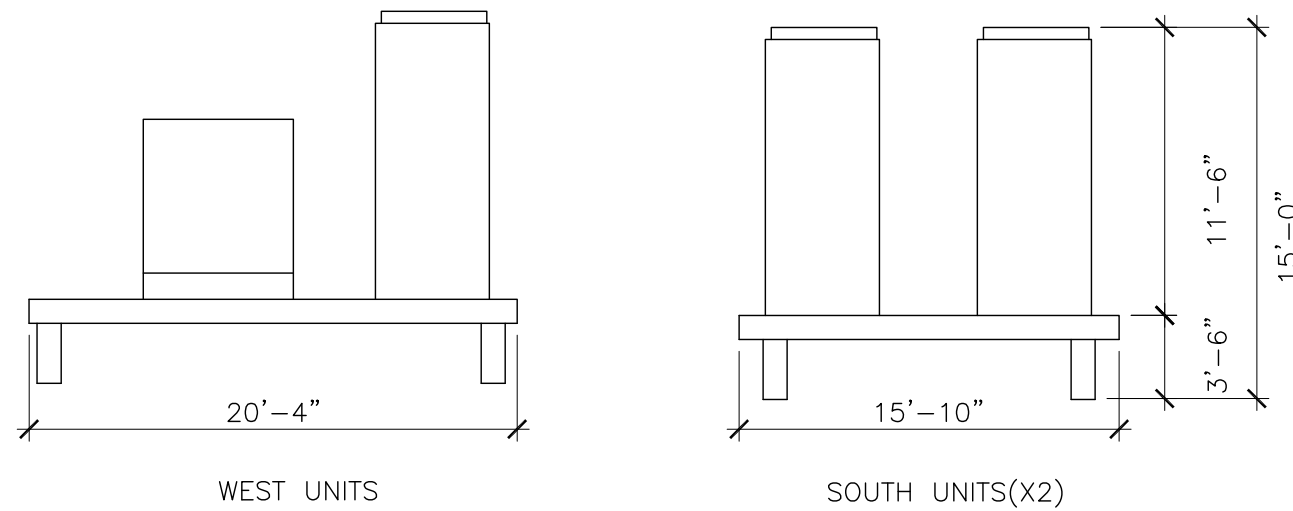

2004/2005 PROPOSED MEP EQUIPMENT – APPROVED

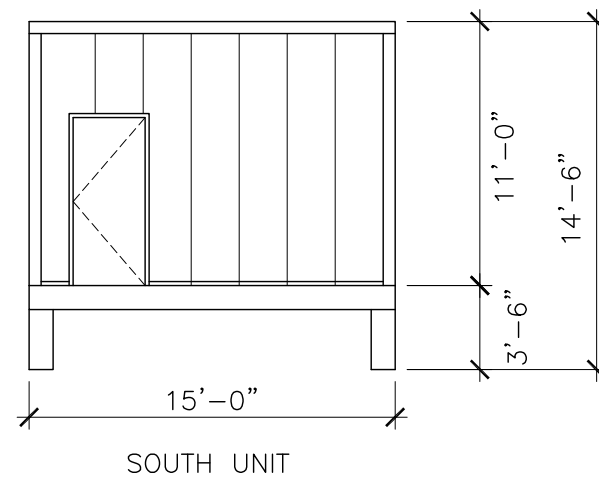

2016 PROPOSED MEP EQUIPMENT

A 2004 / 2005 / 2016 MEP EQUIPMENT COMPARISON

THE BELNORD
225 WEST 86TH STREET
NEW YORK, NEW YORK

NEW YORK CITY
LANDMARKS PRESERVATION
COMMISSION SUBMISSION

**UPPER ROOF
MECHANICAL**

MEPF Engineer
Plus Group Consulting Engineers
231 WEST 29th STREET
#706
New York, NY 10001
(212) 233-2700

**2004 / 2016 MEP
EQUIPMENT COMPARISON**
DRAWING TITLE

DRAWN BY:	NA	SCALE:	AS NOTED
CHECKED BY:	IM	PROJ. NO.:	NA
DATE		10 MARCH 2016	

19
DRAWING NO.



PHOTO #1: Location: Drop 3-7

- 10th Floor
- Brick replacement
- Terra Cotta crack repair
- Terra Cotta pinning

PHOTO #2: Location: Drop 3-7

- 9th Floor
- Brick replacement
- Terra Cotta crack repair
- Terra Cotta pinning

PHOTO #3: Location: Drop 3-7

- 8th Floor
- Terra Cotta crack repair
- Terra Cotta pinning

DURING THE RECENT RESTORATION OF THE MASONRY FACADE, IT WAS DISCOVERED THAT A CRACK ALONG THE SOUTHERN COURTYARD WALL EXTENDING OVER 3 FLOORS WAS CAUSED BY A LEAK IN AN OLD STEAM PIPE WHICH WAS LOCATED INSIDE THE WALL. THE PIPE HAD BEEN LEAKING INSIDE THE WALL AND CORRODED THE COLUMN AND DETERIORATED THE GROUT AND MORTAR HOLDING THE BRICK BACKUP WALL TOGETHER.

2013 - COURTYARD SOUTH FACADE RESTORATION

EXISTING BOILER SYSTEM

THE EXISTING STEAM HEATING SYSTEM CONSISTS OF TWO GAS FIRED BOILERS LOCATED IN SUB-CELLAR. THE STEAM DISTRIBUTION CONSISTS OF A TWO-PIPE SYSTEM AND FEATURES A VACUUM PUMP ON THE CONDENSATE RETURN. THE HEATING SYSTEM STEAM RISERS ARE ALL EMBEDDED WITHIN BUILDING ENVELOPE AROUND THE PERIMETER. THE STEAM AND CONDENSATE PIPING RISERS IN THE BUILDING ARE MOSTLY ORIGINAL AND OVER A CENTURY OLD; HAVE SCALING AND CORROSION AND ARE PAST IT'S USEFUL LIFE. AS IS TYPICAL OF MANY STEAM SYSTEMS THERE ARE ALSO PROBLEMS WITH DISTRIBUTION OF STEAM, KNOCKING AND HAMMERING AND CONTROL OF HEATING WITH LACK OF HEATING.

THE BELNORD HAS BEEN HAVING ISSUES WITH THE CENTURY OLD STEAM SYSTEM THAT IS ORIGINAL TO THE BUILDING. THE EXISTING PIPES, WHICH RUN INSIDE THE WALLS AND FLOORS OF THE BUILDING, HAVE STARTED TO DETERIORATE AND HAVE BEEN CAUSING LEAKS THROUGHOUT THE BUILDING. THE REPAIR OR REPLACEMENT OF THESE EXISTING PIPES WOULD BE INVASION AND DETRIMENTAL TO THE BUILDING AS IT WOULD CONSIST OF BREAKING AND REMOVING WALLS, FLOORS, AND STRUCTURE THROUGHOUT. IN THE PAST YEAR, FOUR LEAKS HAVE OCCURRED DUE TO DETERIORATED AND BROKEN STEAM PIPES. THRU INFRA RED INVESTIGATION, IT WAS FOUND THAT THE STEAM PIPES IN THE FLOOR WERE LEAKING.

PHOTO #4: Elevator #3

- Moisture test was performed at the floor and yielded positive results.

PHOTO #3: Elevator #3

- Overall view of buckled floor at kitchen.

PHOTO #5: Elevator #3

- View of thermal camera image of leak location.
- Note change in temperature at leak location.

PHOTO #1: Apartment 1105

- Overall view of leak location at Apartment 1105 ceiling.

PHOTO #2: Apartment 1105

- View of thermal camera image of leak location.
- Note drop in temperature at leak location.

2015 - LEAK INVESTIGATIONS



1 SOUTHWEST CORNER VIEW OF THE BELNORD




2 SOUTHEAST CORNER VIEW OF THE BELNORD

ROOF STUDY FOR BEST LOCATION FOR PLACEMENT OF NEW MECHANICAL EQUIPMENT

LIST OF DRAWINGS

- RS1 SITE PLAN AND VIEWS
- RS2 ROOF PLAN
- RS3 SUMMARY OF OPTIONS AND SITE MAP

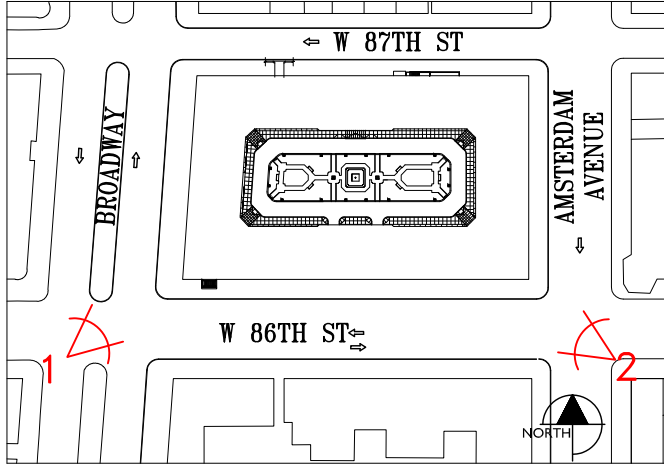

3 SITE PLAN

THE BELNORD
225 WEST 86TH STREET
NEW YORK, NEW YORK

NEW YORK CITY
LANDMARKS PRESERVATION
COMMISSION SUBMISSION

**UPPER ROOF
MECHANICAL**

MEPF Engineer
Plus Group Consulting Engineers
231 WEST 29TH STREET
#706
New York, NY 10001
(212) 233-2700

SITE PLAN AND VIEWS

DRAWING TITLE

SCALE:	AS NOTED
PROJ. NO.	NA
DATE	10 MARCH 2016


RSI
DRAWING NO.

LEGEND

- EXISTING MECHANICAL EQUIPMENT
- PROPOSED MEP BOILER LOCATION
- POSSIBLE MEP BOILER LOCATIONS
- PENTHOUSE ROOF
- EXISTING ELEVATOR BULKHEAD
- EXISTING SKYLIGHT
- EXISTING PIPING

BROADWAY

AMSTERDAM AV.

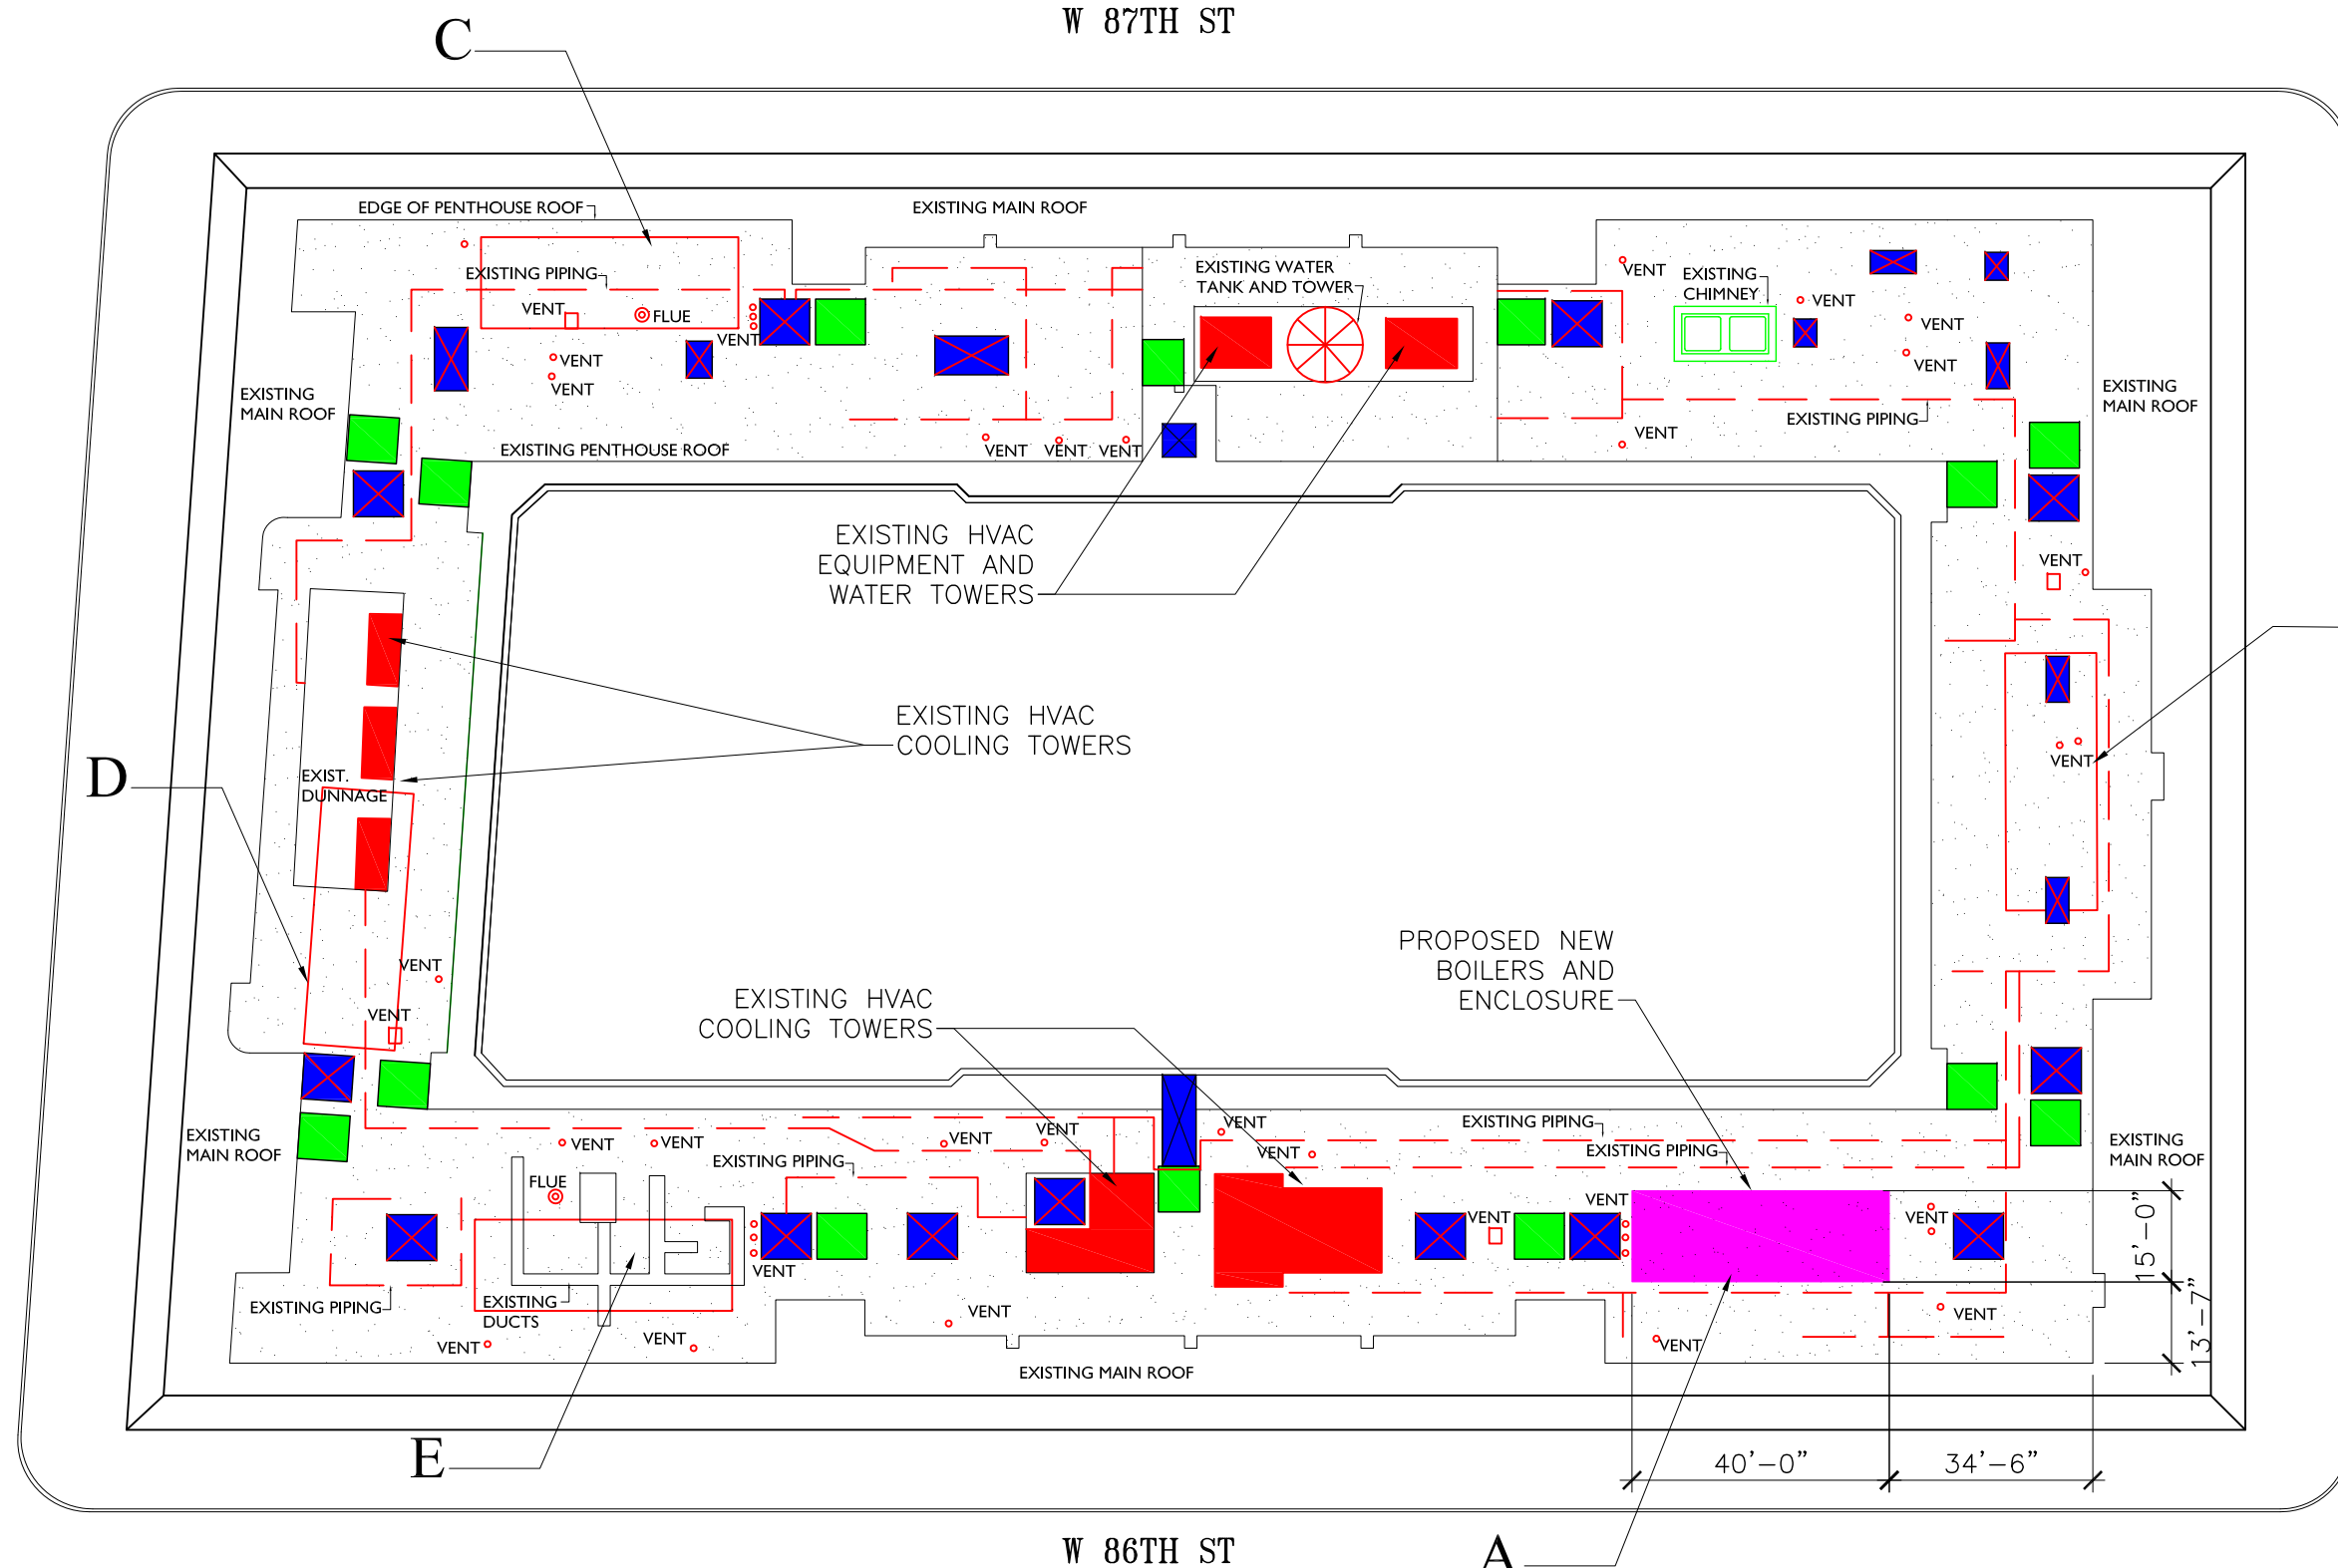

ROOF PLAN

SCALE: 1/32"= 1'0"



THE BELNORD
225 WEST 86TH STREET
NEW YORK, NEW YORK

NEW YORK CITY
LANDMARKS PRESERVATION
COMMISSION SUBMISSION

UPPER ROOF MECHANICAL

MEPF Engineer
Plus Group Consulting Engineers
231 WEST 29th STREET
#706
New York, NY 10001
(212) 233-2700

UPPER ROOF PLAN

DRAWING TITLE

SCALE:	AS NOTED
PROJ. NO.	NA
DATE	10 MARCH 2016

RS2
DRAWING NO.



LEGEND

- PROPOSED MEP BOILER LOCATIONS
- THE BELNORD

SITE PLAN

SCALE: NOT TO SCALE



THE EXISTING COOLING TOWERS ARE SITUATED AT LOCATIONS WHERE THEY ARE MINIMAL TO NONE VISIBLE FROM THE PUBLIC THOROUGHFARE. THEY ARE PLACED ON TOP OF STEEL DUNNAGE AND HAVE PIPES AND CABLES ALREADY LAID OUT ON THE ROOF. THESE TOWERS ARE LARGER THAN THE PROPOSED BOILERS. THESE TOWERS ARE ALMOST IMPOSSIBLE TO RELOCATE WITHOUT EXTENSIVE MODIFICATION TO THE BUILDING STRUCTURE, ROOF, AND EXISTING MECHANICAL INFRASTRUCTURE. EVEN IF THE TOWERS COULD BE MOVED, THEY ARE TALLER AND BIGGER THAN THE PROPOSED BOILERS AND WILL BE MORE VISIBLE FROM THE PUBLIC THOROUGHFARE. WITH ALL THE SKYLIGHTS, ELEVATOR BULKHEADS, EXISTING PIPING, AND CHIMNEY, THERE IS NO LOCATION LARGE ENOUGH TO ACCOMMODATE BOTH THE COOLING TOWER AND THE BOILERS IN A PLACE THAT THEY WILL BE NOT VISIBLE FROM THE STREET OR LESS VISIBLE THAN THE PROPOSED NEW BOILER.

- A. SOUTHEAST SECTION OF 86TH STREET FACADE
- B. CENTER SECTION OF AMSTERDAM FACADE
- C. NORTHWEST SECTION OF 87TH STREET FACADE
- D. CENTER SECTION OF BROADWAY FACADE
- E. SOUTHWEST SECTION OF 86TH STREET FACADE

THE BELNORD
225 WEST 86TH STREET
NEW YORK, NEW YORK

NEW YORK CITY
LANDMARKS PRESERVATION
COMMISSION SUBMISSION

UPPER ROOF
MECHANICAL

MEPF Engineer
Plus Group Consulting Engineers
231 WEST 29th STREET
#706
New York, NY 10001
(212) 233-2700

























SUMMARY OF OPTIONS AND
LOCATIONS ON SITE PLAN

DRAWING TITLE



	SCALE: AS NOTED
	PROJ. NO. NA
	DATE 10 MARCH 2016

RS3	DRAWING NO.

PIPING SYMBOLS

SYMBOL	DESCRIPTION
	HOT WATER SUPPLY/RETURN
	DOMESTIC COLD WATER MAKE-UP
	DRAIN LINE
	VENT LINE
	ARROW INDICATES DIRECTION OF LOW
	PITCH PIPE DOWN IN DIRECTION OF ARROW
	MANUAL AIR VENT
	AUTOMATIC AIR VENT
	THERMOMETER
	PIPE SENSOR WELL
	UNION
	"Y" TYPE STRAINER WITH BLOW-OFF VALVE
	ELBOW TURNED UP
	ELBOW TURNED DOWN
	GATE VALVE
	GLOBE VALVE
	CHECK VALVE
	AUTOMATIC THREE WAY VALVE
	AUTOMATIC TWO WAY VALVE
	RELIEF VALVE
	RELIEF OR SAFETY VALVE
	BALL VALVE
	EQUIPMENT DESIGNATION
	EQUIPMENT TYPE TAG NUMBER

MISCELLANEOUS SYMBOLS

SYMBOL	DESCRIPTION
	SECTION
	REVISION NUMBER

HVAC ABBREVIATIONS

ABBREVIATIONS	DESCRIPTION
A	AMPERES
AC	AIR CONDITIONING
CFM	CUBIC FEET PER MINUTE
DHW	DOMESTIC HOT WATER
DWG	DRAWING
FT	FEET
GPM	GALLONS PER MINUTE
H	HEIGHT
IN	INCH OR INCHES
KW	KILOWATT
L	LENGTH
LBS	POUNDS
NTS	NOT TO SCALE
SS	STAINLESS STEEL
TEMP	TEMPERATURE
TYP	TYPICAL
V	VOLTS
W	WIDTH

EQUIPMENT EFFICIENCIES & UL LISTING #					
EQUIPMENT TAG	MANUFACTURER	MODEL	EFFICIENCY		UL LISTING #
			MIN CODE REQ'D	ACTUAL DOE SEASONAL	
B-1,2,3,4 & 5	HYDROTHERM	KN-30	80% Et	92.7% Et	-

ENERGY ANALYSIS		
ASHRAE TABLE 6.8.1F		
ITEM DESCRIPTION	PROPOSED DESIGN VALUE	CODE PRESCRIPTIVE VALUE AND CITATION
NEW GAS FIRED BOILER (6,000,000 BTU/H) > 2,500,000 BTU/H	92.7% Ec	82% Ec
HOT WATER PIPING INSULATION	1.5 INCH FOR PIPES =< 1½" FOR PIPES 2.0 INCH FOR PIPES > 1½" FOR PIPE	MINIMUM PIPE INSULATION ASHRAE TABLE 6.8.3

BUILDING DEPARTMENT NOTES - HVAC


- NYC BUILDING DEPT. NOTES
- GENERAL NOTES
- ALL WORK AND COMPONENTS SHOWN ON THESE PLANS COMPLY WITH THE NEW YORK BUILDING LAWS (LL 33/2008) AS AMENDED TO THIS DATE.
 - NEW YORK STATE ENERGY CONSERVATION RULES AND REGULATIONS HAVE BEEN FOLLOWED.

SPECIAL INSPECTIONS - MECHANICAL

- THE FOLLOWING SPECIAL INSPECTIONS ARE REQUIRED AS DESCRIBED IN THE NEW YORK CITY 2014 BUILDING CODE:
- SPECIAL INSPECTIONS:
- | | |
|-----------------|------------|
| HEATING SYSTEMS | BC 1704.25 |
| CHIMNEYS | BC 1704.26 |
| FIRESTOPS | BC 1704.27 |

ENERGY COMPLIANCE STATEMENT

TO THE BEST OF MY KNOWLEDGE, BELIEF AND PROFESSIONAL JUDGEMENT, THIS APPLICATION IS IN COMPLIANCE WITH ASHRAE 2010 90.1.

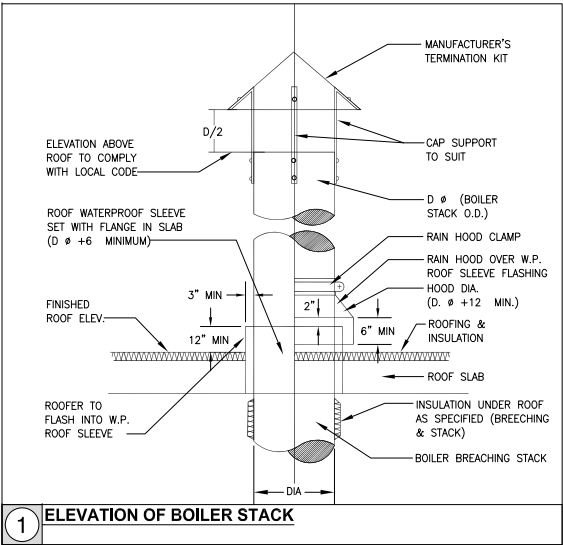

ELEVATION OF BOILER STACK

- BOILER ROOM NOTES:
- THE DOOR SHALL BE 1½ HR FIRE RATED SELF-CLOSING DOOR. DOOR SHALL SWING OUTWARDS FROM BOILER ROOM.
 - BOILER ROOM FLOOR IS CONCRETE SLAB ON GRADE NON-COMBUSTIBLE CONSTRUCTION FOR COMPLIANCE WITH MC1004.5.
 - BOILERS ARE HOT WATER PACKAGE HEATING BOILERS WITHOUT MANHOLE ON TOP. INPUT OF 600,000BTU/H EACH. THE CLEARANCE ABOVE BOILER SHALL BE 2FT. MIN. FOR COMPLIANCE WITH MC. 1004.3.1.
 - COMBUSTION AIR SHALL BE PROVIDED FOR DIRECT COMBUSTION AIR CONNECTION TO OUTDOOR IN ACCORDANCE WITH MC707 AND FGC 304.1.1.
 - THE BOILER IS GAS FIRED DIRECT VENT CONDENSING TYPE. THE VENTING SHALL BE PROVIDED IN ACCORDANCE WITH FGC SEC.503.2.2. AND FGC SEC. 503.8.
 - PROVIDE VIBRATION ISOLATION FOR BOILERS, MC.1004.4. PROVIDE SIESMIC RESTRAINT.
 - PROVIDE PRIMARY AND SECONDARY LOW WATER CUT-OFF FOR EACH BOILER WIRED TO STOP COMBUSTION OPERATION WHEN WATER LEVEL DROPS BELOW SAFE LEVEL ESTABLISHED BY MFR.

AIR SEPARATOR SCHEDULE								
ITEM	MANUFACTURER	MODEL NO.	SYSTEM SERVING	PIPE SIZE	MAX. INLET PRESSURE PSIG	MAX. OPERATING PRESSURE PSIG	OPERATING FLOW GPM	NOTES
AS-1	TACO	4906AD-125	HTG. SYSTEM	6	75	125	475	FLANGED CONNECTIONS


HEAT EXCHANGER SCHEDULE																		
ITEM	MANUFACTURER	MODEL	TYPE	LOAD BTU/H	HOT SIDE				COLD SIDE				HEAT TRANSFER AREA	NUMBER OF PLATES	MATERIAL	DIMENSIONS LXWXH	OPERATING WEIGHT (LBS)	CERTIFICATION
					EWT	LWT	GPM	PD (PSI)	EWT	LWT	GPM	PD (PSI)						
HX-1	TACO	PF50-49-4-NH	PLATE FRAME	4,180,000	150	90	141.4	4.2	60	120	150.0	6.2	253.0	60	ALLOY 304 / 0.50 MM	28 X 19 X 73	1,500	ASME, SECTION VIII, DIV. 1
HX-2	TACO	PF50-49-4-NH	PLATE FRAME	4,180,000	150	90	141.4	4.2	60	120	150.0	6.2	253.0	60	ALLOY 304 / 0.50 MM	28 X 19 X 73	1,500	ASME, SECTION VIII, DIV. 1
HX-3	TACO	PF50-31-4-NH	PLATE FRAME	2,920,000	150	108.1	142.0	3.4	60	120	105.0	3.3	156.08	60	ALLOY 304 / 0.50 MM	28 X 19 X 73	1,320	ASME, SECTION VIII, DIV. 1

EXPANSION TANK SCHEDULE													
TAG	MANUFACTURER	MODEL NO.	LOCATION	SYSTEM SERVED	MIN ACCEPTANCE VOLUME GALLONS	EXPANSION VOLUME WATER GALLONS	HEIGHT	DIA.	MINIMUM CHARGE PRESSURE PSIG	MAXIMUM UNIT PRESSURE PSIG	SYSTEM OPERATING TEMP. (°F)	OPERATING WEIGHT	CERTIFICATION
							IN	IN	PSIG	PSIG		LBS	
ET-1	TACO	CBX-170-125	BOILER RM	HTG. SYSTEM	24	45	44	20	12	30	150	450	-

HOT WATER BOILER SCHEDULE																									
ITEM	MANUFACTURER	MODEL	LOCATION	INPUT MBH	OUTPUT MBH	WATER TEMP		WATER FLOW RATE (GPM)	PRESSURE DROP FT (H2O)	MAXIMUM WORKING PRESSURE (PSIG)	OPERATING PRESSURE (PSIG)	RELIEF VALVE SETTING (PSIG)	BURNER (GAS DATA)			NOT TO EXCEED DIMENSIONS				ELECTRICAL DATA				OPERTING WT LBS	UL LISTING
						ENT	LVG						NAT GAS (CFH)	GAS PRESS (IN WG)		WIDTH (IN)	DEPTH (IN)	HEIGHT (IN)	FLUE (IN DIA)	VOLTS	PH	HZ	AMPS		
						°F	°F							MIN	MAX										
B-1,2,3,4,5	HYDROTHERM	KN-30	BOILER ROOM	3,000	2,781	90	150	95	10	100 @ 250°F	60	65	3,000	3	14	32	81	72	8"	208	3	60	6.3	3,700	—
NOTES: 1. PROVIDE COMMON VENTING MANIFOLD AND CONDENSATE NEUTRALIZER/DRAIN. 2. PROVIDE BOILER CONTROLS TO INCLUDE BOILER STAGING, SYSTEM PUMP CONTROL. SEE SPECIFICATIONS.																									

PUMP SCHEDULE																
TAG	MANUFACTURER	TYPE	MODEL #	SERVICE	LOCATION	FLOW RATE GPM	EFFICIENT (%)	WORKING FLUID	HEAD (FT H2O)	MOTOR DATA			WEIGHT (LBS)	ISOLATION		NOTES
										RPM	HP	VOLT/PH/HZ		TYPE	DEFL. (IN)	
P-1,2	TACO	SELF-SENSING VARIABLE SPEED	SKV-4009	HTG. SYSTEM	BOILER RM	427.5	68	WATER	60	1,760	10	208/3/60	520	SPRING	2	DUPLEX W/ VFD (RUN & STANDBY)
P-3,4	TACO	SELF-SENSING VARIABLE SPEED	SKV-3007	HTG. SYSTEM	BOILER RM	148	69	40% GLYCOL	35	1,760	3.0	208/3/60	250	SPRING	2	-
P-5	TACO	SELF-SENSING VARIABLE SPEED	SKV-3007	HTG. SYSTEM	BOILER RM	105	64	40% GLYCOL	35	1,760	2.0	208/3/60	250	SPRING	2	-

THRU-THE-WALL AC UNIT SCHEDULE												
TAG	MANUFACTURER & MODEL	MODEL #.	SERVICE	CFM	TOTAL COOLING (BTUH)	TOTAL HEATING ELECTRIC (BTUH)	HEATING (WATTS)	ELECTRICAL DATA		EER	UNIT DIMENSIONS HxWxD	IN-WALL INSTALLATION DIMENSIONS HxWxD
								Volt/Ph/Hz	AMPS			
AC-1, 2	FRIEDRICH UNI-FIT	UE12D33C	BOILER ROOM	290	11,200	11,200	3,500	208/1/60	15.3	9.8	16"x26"x17"	18"x28"x20"
NOTES: PROVIDE WALL SLEEVE & EXTERIOR LOUVER ASSEMBLY.												

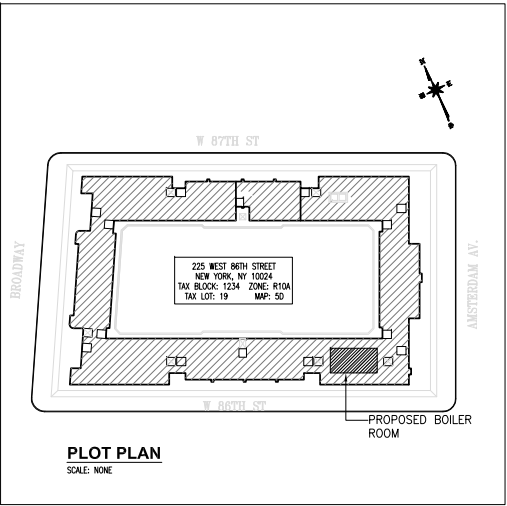

NEW YORK CITY BUILDING DEPARTMENT NOTE

THIS PLAN IS APPROVED ONLY FOR WORK INDICATED ON THE APPLICATION SPECIFICATION SHEET. ALL OTHER MATTERS SHOWN ARE NOT TO BE RELIED UPON, OR TO BE CONSIDERED AS EITHER BEING APPROVED OR IN ACCORDANCE WITH APPLICABLE CODES.

THE BELNORD




225 W 86TH ST,
New York, New York 10024

Plus Group
Consulting Engineers
MEPP Engineer
231 West 29th Street, #708
New York, NY 10001
212.233.2700 tel

Date: 07.28.15
Issue: Concept Scheme
11.10.15 Pricing Set
11.16.15 Bid Issue

BOILER SYMBOLS,
ABBREVIATION,
SCHEDULES, AND
DETAILS

BL-001.00

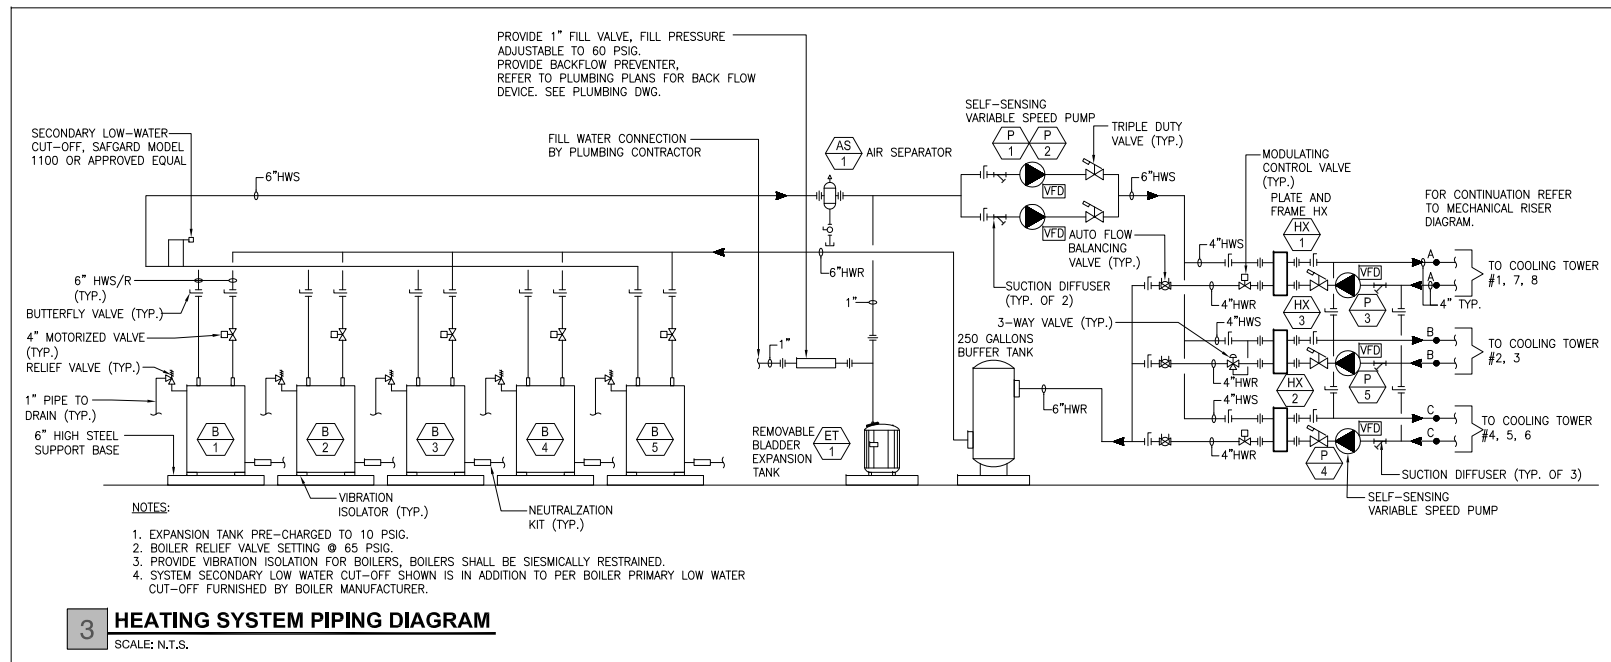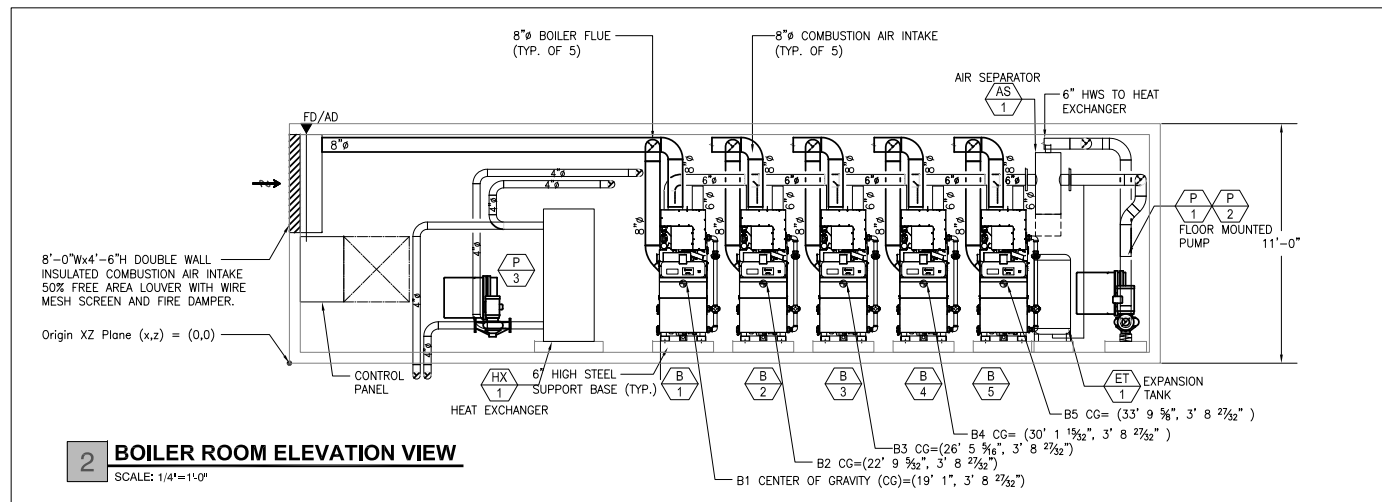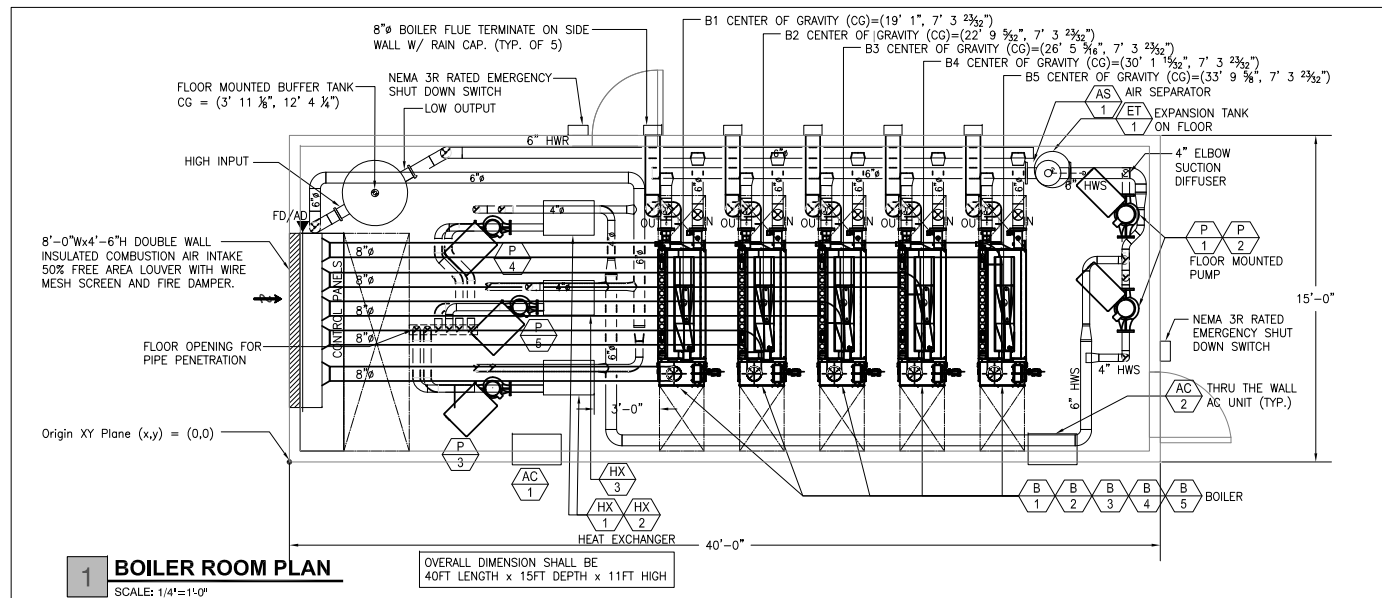

THE BELNORD
225 W 86TH ST.
New York, New York 10024

Plus Group
Consulting Engineers
MEPF Engineer
231 West 29th Street, #706
New York, NY 10001
212.233.2700 tel

Date:	Issue:
07.29.15	Concept Scheme
11.10.15	Pricing Set
11.16.15	Bld Issue


BOILER ROOM PLAN,
BOILER ELEVATION
VIEW & HEATING
SYSTEM PIPING
DIAGRAM

BL-101.00

02 OF 06

NEW YORK CITY BUILDING DEPARTMENT NOTE

THIS PLAN IS APPROVED ONLY FOR WORK INDICATED ON THE APPLICATION SPECIFICATION SHEET. ALL OTHER MATTERS SHOWN ARE NOT TO BE RELIED UPON, OR TO BE CONSIDERED AS EITHER BEING APPROVED OR IN ACCORDANCE WITH APPLICABLE CODES.

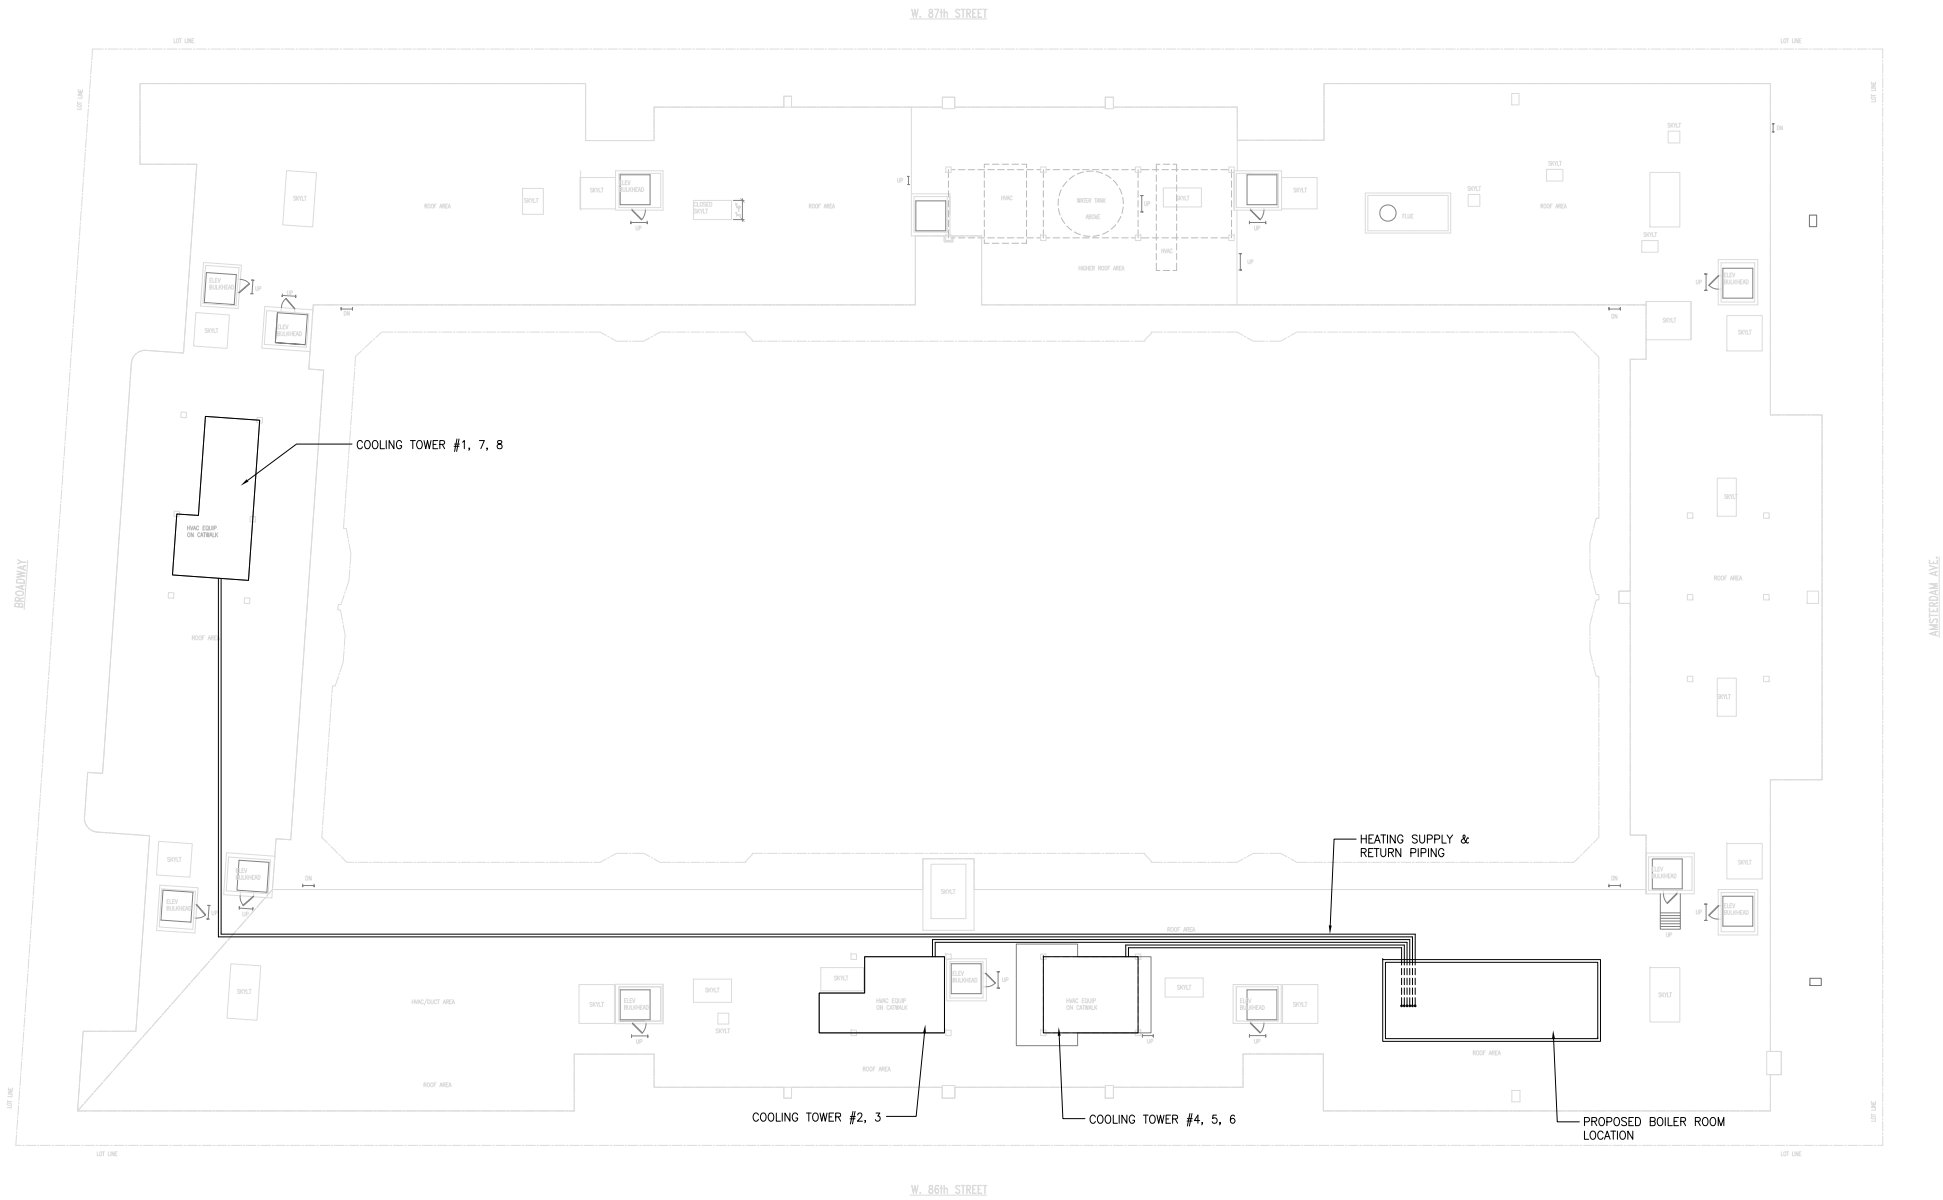

NEW YORK CITY BUILDING DEPARTMENT NOTE
THIS PLAN IS APPROVED ONLY FOR WORK INDICATED ON THE APPLICATION SPECIFICATION SHEET. ALL OTHER MATTERS SHOWN ARE NOT TO BE RELIED UPON, OR TO BE CONSIDERED AS EITHER BEING APPROVED OR IN ACCORDANCE WITH APPLICABLE CODES.




THE BELNORD
225 W 86TH ST.
New York, New York 10024

Plus Group
Consulting Engineers
MEPF Engineer
231 West 29th Street, #706
New York, NY 10001
212.233.2700 tel

Date:	Issue:
07.28.15	Concept Scheme
11.10.15	Pricing Set
11.16.15	Bld Issue

ROOF MECHANICAL
PLAN

BL-102.00

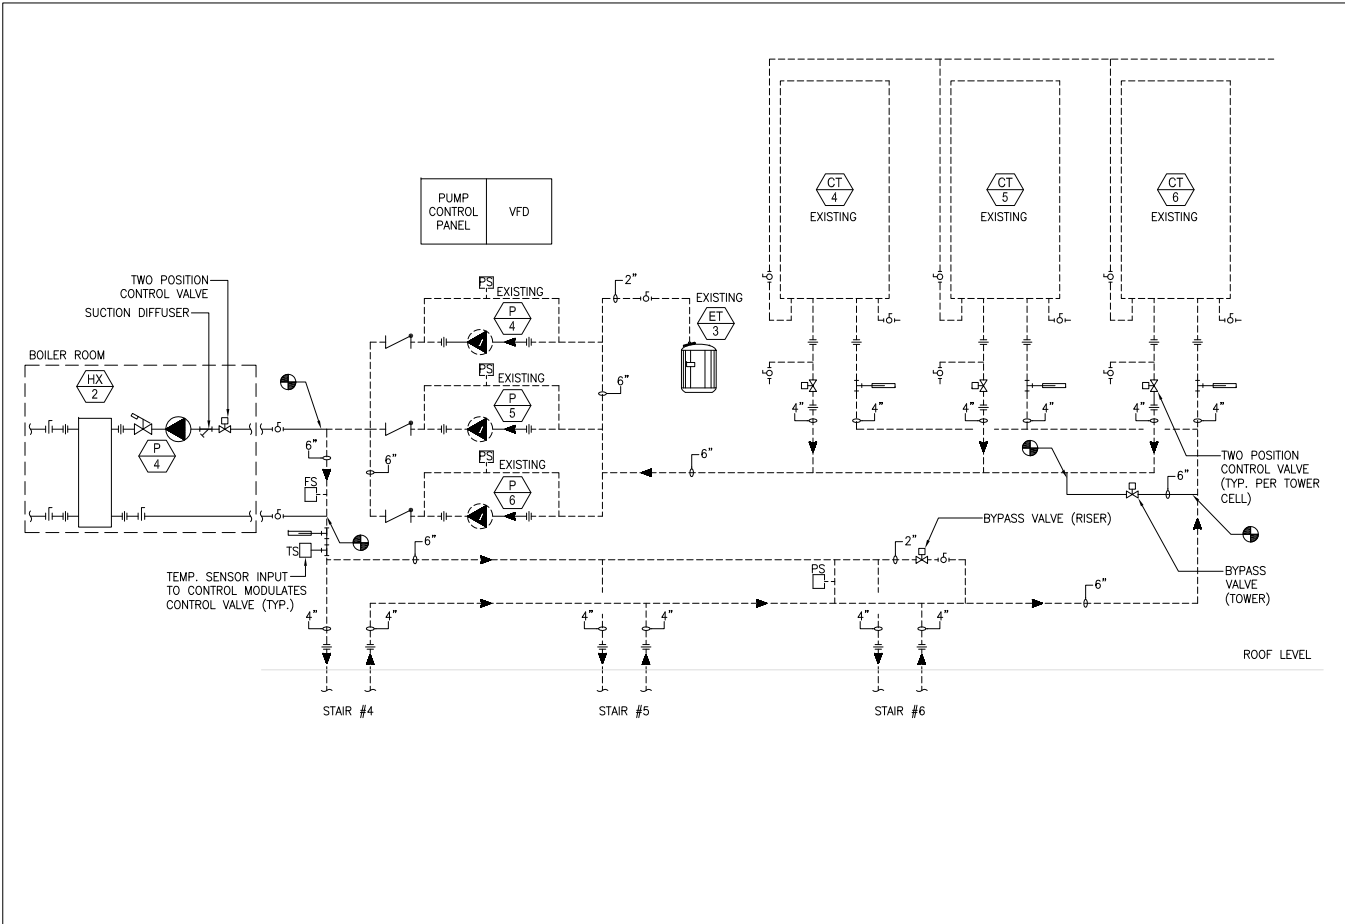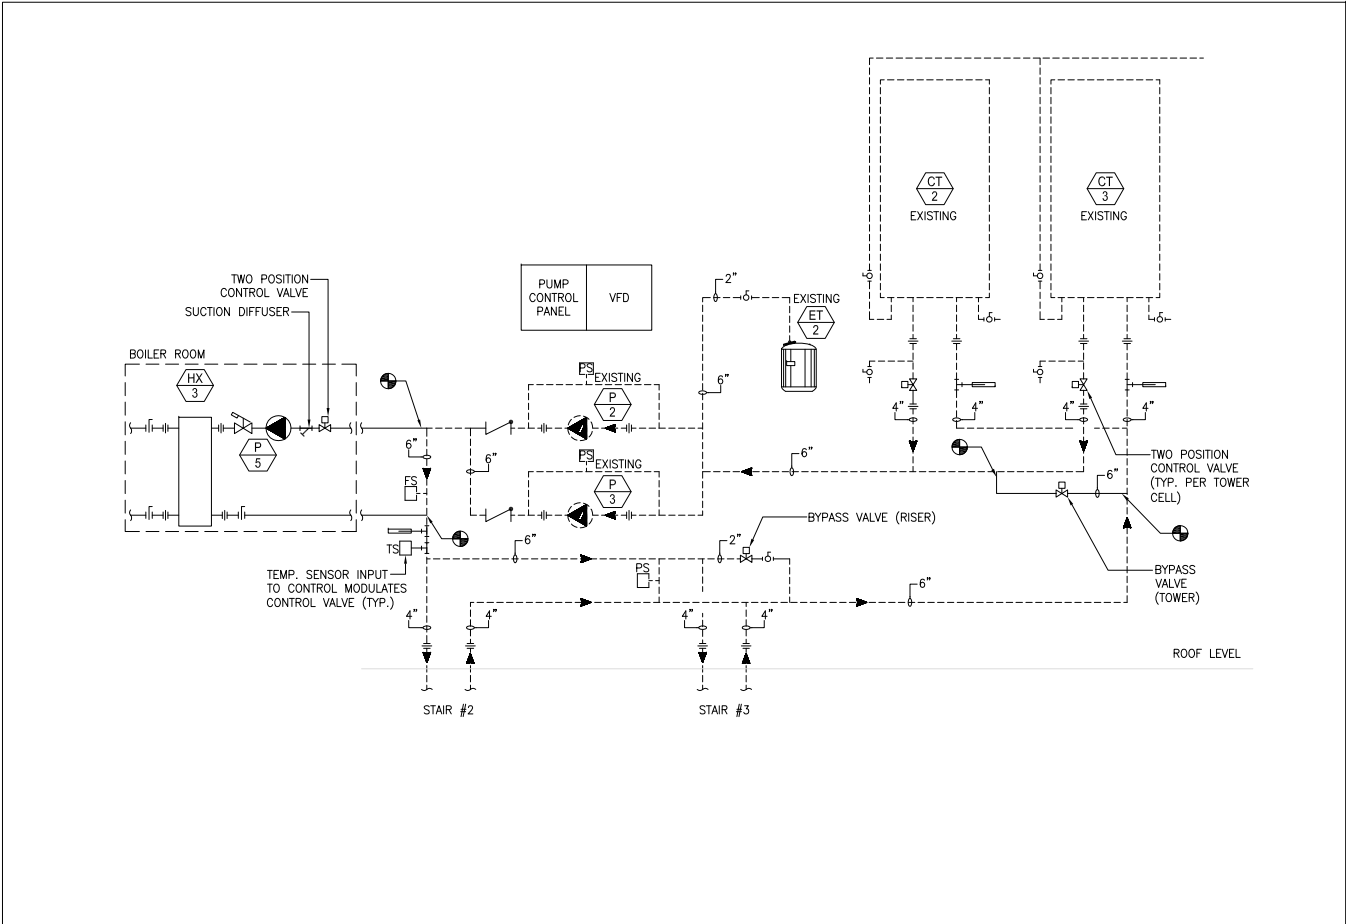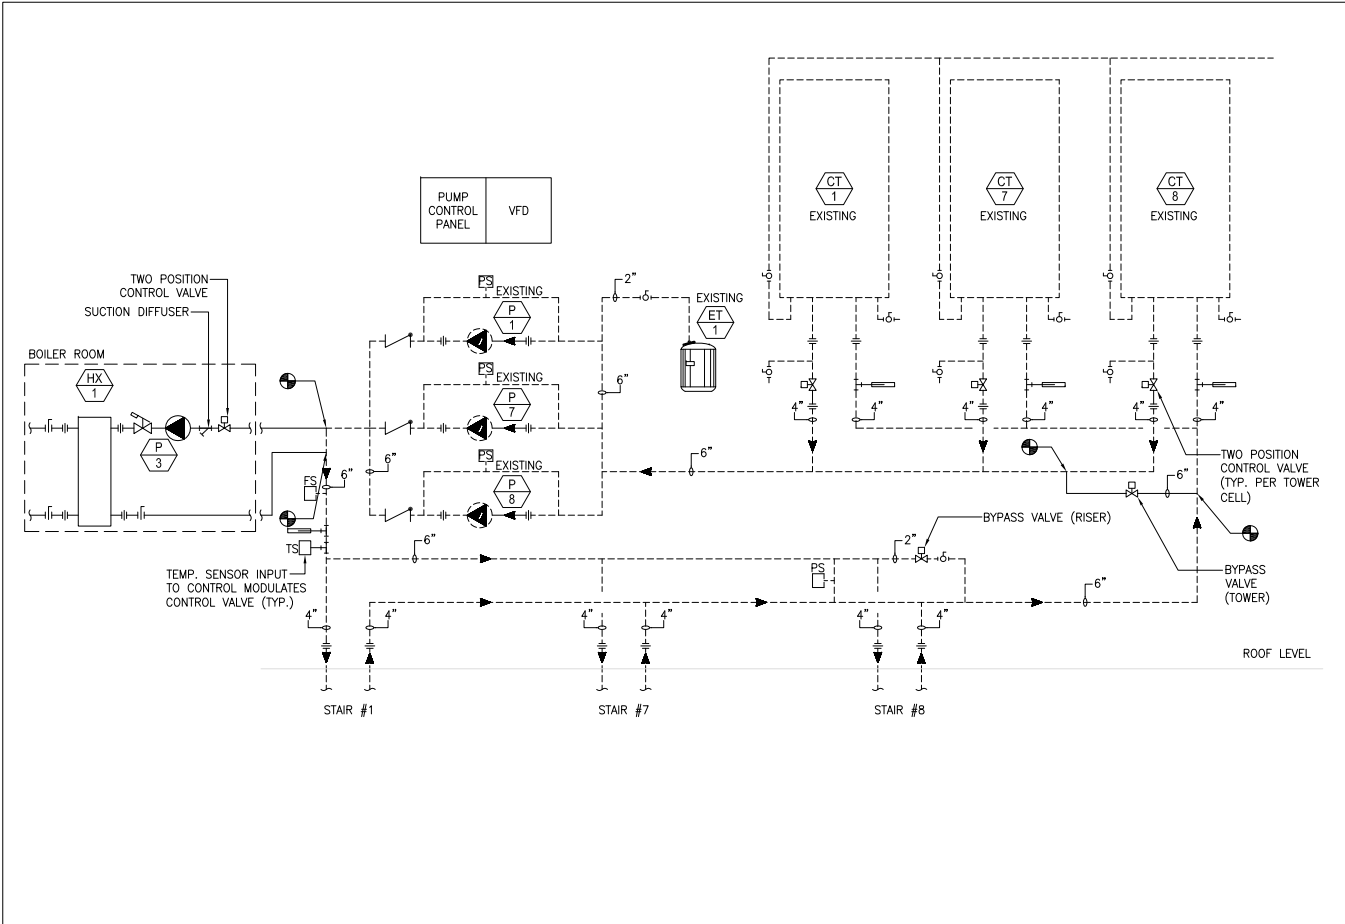

NEW YORK CITY BUILDING DEPARTMENT NOTE

THIS PLAN IS APPROVED ONLY FOR WORK INDICATED ON THE APPLICATION SPECIFICATION SHEET. ALL OTHER MATTERS SHOWN ARE NOT TO BE RELIED UPON, OR TO BE CONSIDERED AS EITHER BEING APPROVED OR IN ACCORDANCE WITH APPLICABLE CODES.

THE BELNORD

225 W 86TH ST.
New York, New York 10024


Plus Group
Consulting Engineers
ME/PE Engineer
231 West 29th Street, #706
New York, NY 10001
212.233.2700 tel

Date: Issue:
07.28.15 Concept Scheme
11.10.15 Pricing Set

11.16.15 Bld Issue

HEATING SYSTEM
PIPING DIAGRAM

BL-201.00

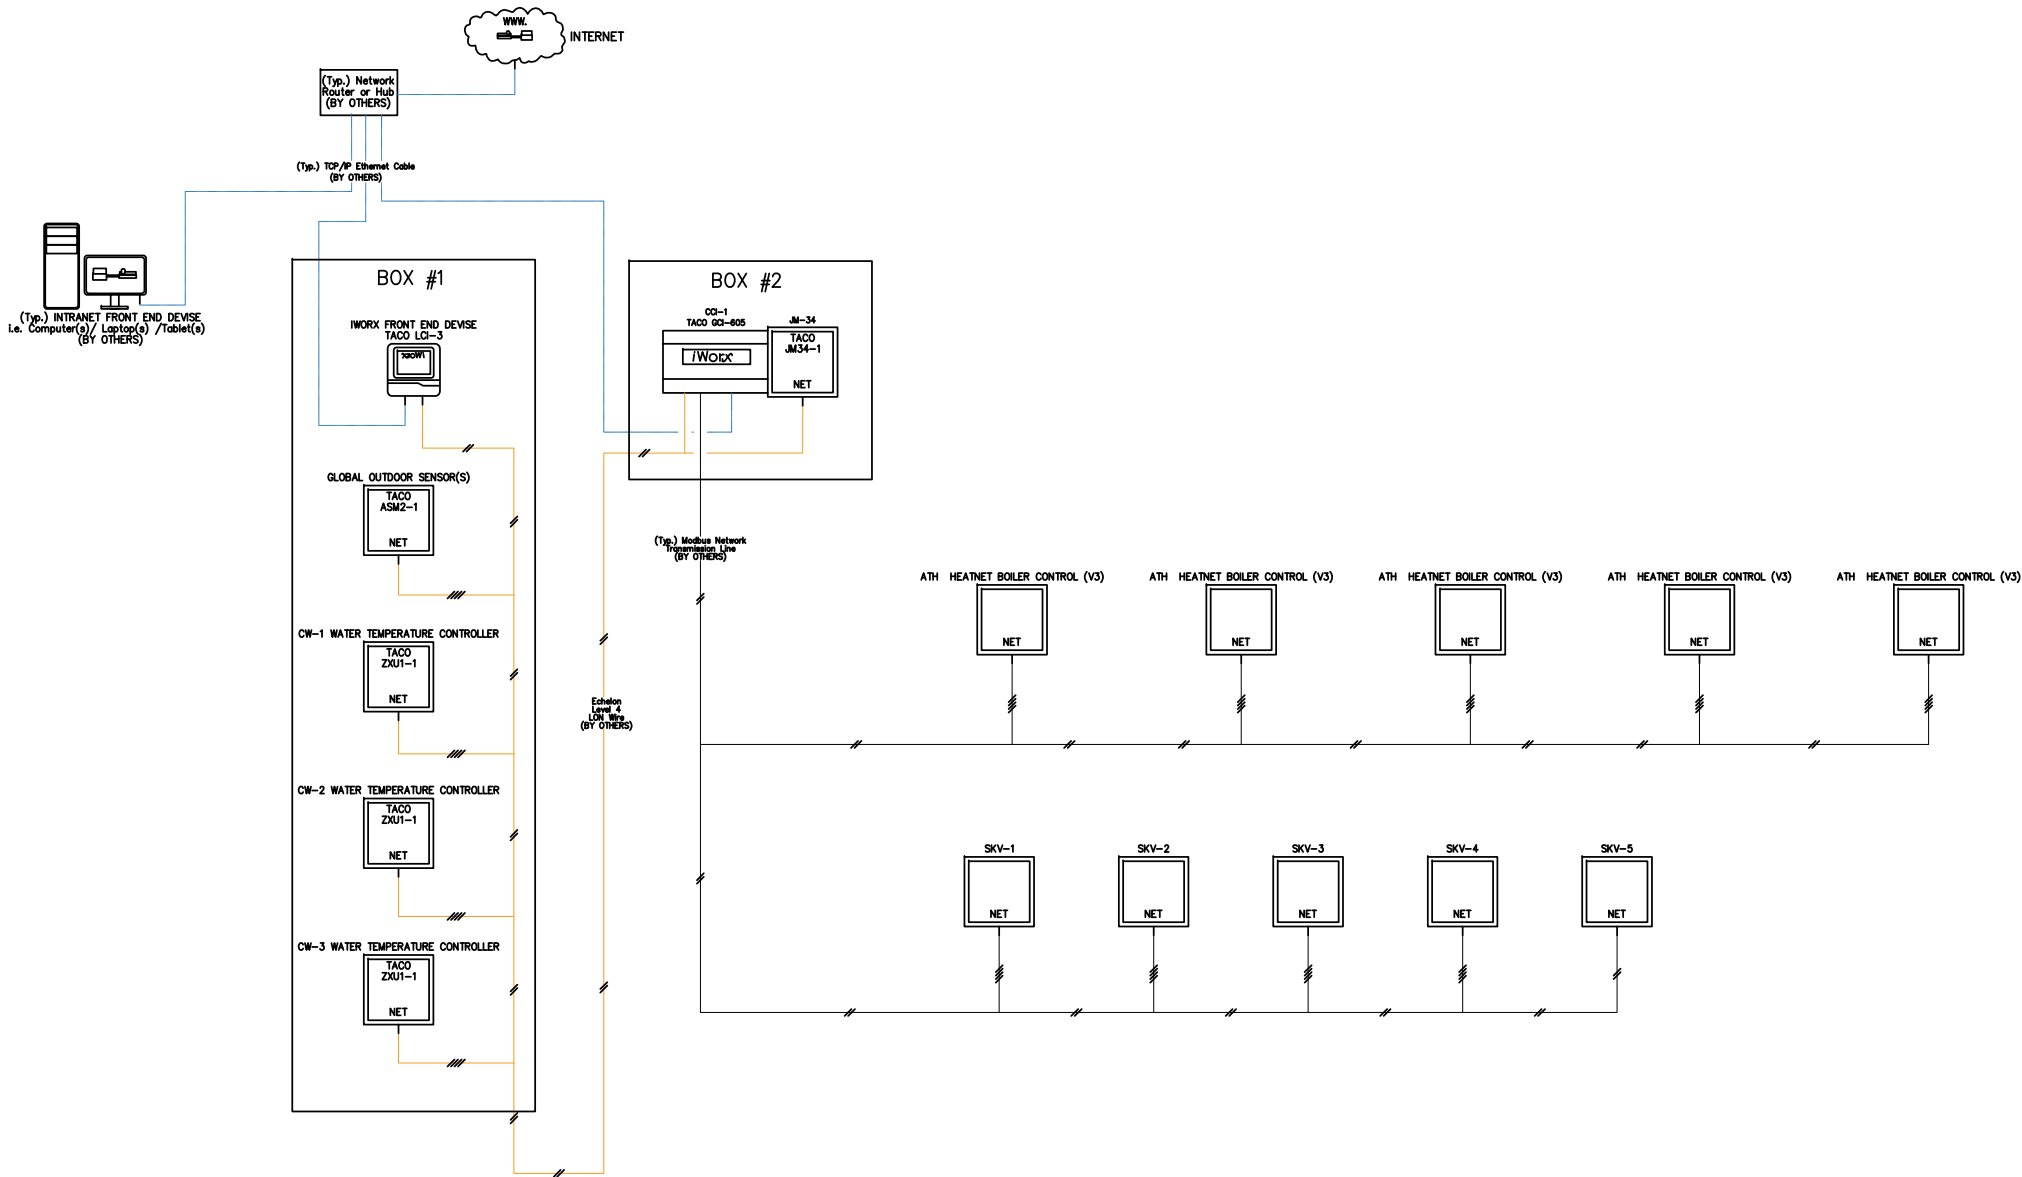

AUXILIARY SENSOR TACO ASM2-1 POINTS LIST		
POINT	DESCRIPTION	DEVICE
AI-2	OUTDOOR AIR TEMPERATURE	TEMPERATURE SENSOR
GLOBAL OUTDOOR SENSOR(S)		

MIXING LOOP - SINGLE ZONE TACO ZXU1-1 POINTS LIST		
POINT	DESCRIPTION	DEVICE
AI-2	SUPPLY WATER TEMPERATURE	TEMPERATURE SENSOR
AI-3	RETURN WATER TEMPERATURE	TEMPERATURE SENSOR
AI-4	ZONE AIR TEMPERATURE	TEMPERATURE SENSOR
DI-1	DEMAND HEATING	OTHER
AO-1	ZONE VALVE	VALVE OPERATOR
DO-1	ZONE PUMP	OTHER
DO-6	BOILER ENABLE	OTHER
CW-1 WATER TEMPERATURE CONTROLLER		

MIXING LOOP - SINGLE ZONE TACO ZXU1-1 POINTS LIST		
POINT	DESCRIPTION	DEVICE
AI-2	SUPPLY WATER TEMPERATURE	TEMPERATURE SENSOR
AI-3	RETURN WATER TEMPERATURE	TEMPERATURE SENSOR
AI-4	ZONE AIR TEMPERATURE	TEMPERATURE SENSOR
DI-1	DEMAND HEATING	OTHER
AO-1	ZONE VALVE	VALVE OPERATOR
DO-1	ZONE PUMP	OTHER
DO-6	BOILER ENABLE	OTHER
CW-2 WATER TEMPERATURE CONTROLLER		

MIXING LOOP - SINGLE ZONE TACO ZXU1-1 POINTS LIST		
POINT	DESCRIPTION	DEVICE
AI-2	SUPPLY WATER TEMPERATURE	TEMPERATURE SENSOR
AI-3	RETURN WATER TEMPERATURE	TEMPERATURE SENSOR
AI-4	ZONE AIR TEMPERATURE	TEMPERATURE SENSOR
DI-1	DEMAND HEATING	OTHER
AO-1	ZONE VALVE	VALVE OPERATOR
DO-1	ZONE PUMP	OTHER
DO-6	BOILER ENABLE	OTHER
CW-3 WATER TEMPERATURE CONTROLLER		

34 POINT I/O EXPANSION MODULE TACO JM34-1 POINTS LIST		
POINT	DESCRIPTION	DEVICE
AI-1	MECHANICAL ROOM TEMP	TEMPERATURE SENSOR
DI-1	BOILER ISOLATION VALVE	OTHER
DI-2	BOILER ISOLATION VALVE	OTHER
DI-3	BOILER ISOLATION VALVE	OTHER
DI-4	BOILER ISOLATION VALVE	OTHER
DI-5	BOILER ISOLATION VALVE	OTHER
JM-34		

WIRE LEGEND	
	= Typ. 18 AWG Low Voltage (24 VAC) Wire
	= Typ. 18 AWG 0-10 VDC Control Signal Wire
	= Typ. Level 4 Echelon Approved Network Communication Wire (WR-022)
	= Typ. 18 AWG SHIELDED Sensor Wire (WR-018)
	= Typ. 18 AWG Wire
	= Typ. Line Voltage Wire
	= Typ. BACnet IP Network Communication Wire
	= Typ. Ethernet Cable
	= Typ. Modbus Network Communication Wire

- NOTES:
- All iWorx controller MUST be properly grounded.
 - iWorx controller power source (transformer) MUST also be properly grounded.
 - All 18 AWG shielded cable wiring used for sensor(s) MUST be properly grounded.
 - Controller jumper placements must be configured PRIOR to installing power.
 - Network communication wire MUST be 22 AWG Echelon approved Level 4 wire (WR-022)
 - Maximum iWorx LON communication wire (WR-022) length: 1,640 feet.
 - Should project requirements exceed the maximum total network wire limitations, a LON signal repeater will be required
 - Port(s) 11000 & 11001 must be forwarded by the building IT manager for remote access.
 - Typical ethernet cables, router and network hardware BY OTHERS.
 - GCI gateway integration MUST be performed by a Niagara AX certified professional.
 - The installer MUST review all iWorx product installation and application manuals prior to installation of material(s)

1

IWORX SYSTEM NETWORK ARCHITECTURE & POINT LIST OVERVIEW (REV 1)

SCALE: N.T.S.

NEW YORK CITY BUILDING DEPARTMENT NOTE

THIS PLAN IS APPROVED ONLY FOR WORK INDICATED ON THE APPLICATION SPECIFICATION SHEET. ALL OTHER MATTERS SHOWN ARE NOT TO BE RELIED UPON, OR TO BE CONSIDERED AS EITHER BEING APPROVED OR IN ACCORDANCE WITH APPLICABLE CODES.

THE BELNORD
225 W 86TH ST.
New York, New York 10024

Plus Group
Consulting Engineers
ME/PE Engineer
231 West 29th Street, #706
New York, NY 10001
212.233.2700 tel

Date: 07.28.15 Issue: Concept Scheme
11.10.15 Pricing Set
11.16.15 Bid Issue

HEATING SYSTEM
CONTROL DIAGRAM

BL-203.00